

Flanges and their joints — Circular flanges for pipes, valves, fittings and accessories, PN designated

Part 2. Cast iron flanges

The European Standard EN 1092-2 : 1997 has the status of a
British Standard

ICS 23.040.60

NO COPYING WITHOUT BSI PERMISSION EXCEPT AS PERMITTED BY COPYRIGHT LAW



S

A vertical barcode located on the left side of the page.

Committees responsible for this British Standard

The preparation of this British Standard was entrusted to Technical Committee PSE/15, Flanges, upon which the following bodies were represented:

- British Compressed Gases Association
- British Foundry Association
- British Iron and Steel Producers' Association
- British Malleable Tube Fittings Association
- British Plumbing Fittings Manufacturers' Association
- British Pump Manufacturers' Association
- British Valve and Actuator Manufacturers' Association
- Confederation of British Forgers
- Copper Development Association
- Energy Industries Council
- Engineering Equipment and Materials Users' Association
- GAMBICA (BEAMA Ltd.)
- Power Generation Contractors Association (PGCA (BEAMA Ltd.))

This British Standard, having been prepared under the direction of the Sector Board for Engineering, was published under the authority of the Standards Board and comes into effect on 15 September 1997

© BSI 1997

Amendments issued since publication

| Amd. No. | Date | Text affected |
|----------|------|---------------|
| | | |
| | | |
| | | |
| | | |

The following BSI references relate to the work on this standard:
Committee reference PSE/15
Draft for comment 93/707537 DC

ISBN 0 580 27962 6

Contents

| | Page |
|------------------------|--------------------|
| Committees responsible | Inside front cover |
| National foreword | ii |
| Foreword | 2 |
| Text of EN 1092-2 | 3 |



5*

National foreword

This Part of BS EN 1092 has been prepared by Technical Committee PSE/15, and is the English language version of EN 1092-2 : 1997 *Flanges and their joints — Circular flanges for pipes, valves, fittings and accessories, PN designated — Part 2: Cast iron flanges*, published by the European Committee for Standardization (CEN). It supersedes BS 4504 : Section 3.2 : 1989 which is withdrawn.

Cross-references

| Publication referred to | Corresponding British Standard |
|--------------------------------|---|
| EN 545 : 1994 | BS EN 545 : 1995 <i>Ductile iron pipes, fittings, accessories and their joints for water pipelines. Requirements and test methods</i> |
| EN 1333 : 1996 | BS EN 1333 : 1997 <i>Pipework components. Definition and selection of PN</i> |
| EN ISO 6708 : 1995 | BS EN ISO 6708 : 1996 <i>Pipework components. Definition and selection of DN (nominal size)</i> |
| EN ISO 9002 : 1994 | BS EN ISO 9002 : 1994 <i>Quality systems. Model for quality assurance in production, installation and servicing</i> |

Compliance with a British Standard does not of itself confer immunity from legal obligations.

Summary of pages

This document comprises a front cover, an inside front cover, pages i and ii, the EN title page, pages 2 to 28, an inside back cover and a back cover.

EUROPEAN STANDARD

EN 1092-2

NORME EUROPÉENNE

EUROPÄISCHE NORM

April 1997

ICS 23.040.60

Descriptors: Industrial piping, pipe flanges, cast iron, spheroidal graphite cast iron, malleable cast iron, unalloyed cast iron, designation, dimensions, dimensional tolerances, specifications, surface condition, marking

English version

**Flanges and their joints — Circular flanges for pipes, valves,
fittings and accessories, PN designated —
Part 2: Cast iron flanges**

Brides et leurs assemblages — Brides circulaires
pour tuyaux, appareil de robinetterie, raccords et
accessoires, désignées PN —
Partie 2: Brides en fonte

Flansche und ihre Verbindungen — Runde Flansche
für Rohre, Armaturen, Formstücke und
Zubehörteile, nach PN bezeichnet —
Teil 2: Gußeisenflansche

This European Standard was approved by CEN on 1996-12-29. CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration.

Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Central Secretariat or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Central Secretariat has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and United Kingdom.

CEN

European Committee for Standardization
Comité Européen de Normalisation
Europäisches Komitee für Normung

Central Secretariat: rue de Stassart 36, B-1050 Brussels

© 1997 All rights of exploitation in any form and by any means reserved worldwide for CEN national members.

Ref. No. EN 1092-2 : 1997 E

Foreword

This European Standard has been prepared by Technical Committee CEN/TC 74, Flanges and their joints, the secretariat of which is held by DIN. EN 1092 will consist of the following six Parts:

- Part 1: *Steel flanges*
- Part 2: *Cast iron flanges*
- Part 3: *Copper alloy flanges*
- Part 4: *Aluminium alloy flanges*
- Part 5: *Flanges in other metallic materials*
- Part 6: *Non-metallic flanges*

This standard is related to ISO 7005-2 : 1988 and ISO 2531 : 1991 in respect of flanges having the same PN designation. The types of flanges and their mating dimensions are compatible with those flanges of the same DN and PN given in ISO 7005-2 : 1988 and ISO 2531 : 1991.

The mating dimensions of the flanges of this standard are compatible with those flanges of other materials in accordance with the other parts of EN 1092.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by October 1997, and conflicting national standards shall be withdrawn at the latest by October 1997.

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Iceland, Ireland, Italy, Luxembourg, Netherlands, Norway, Portugal, Spain, Sweden, Switzerland and the United Kingdom.

Contents

| | | |
|---|------|---|
| Foreword | Page | 2 |
| Introduction | | 3 |
| 1 Scope | | 3 |
| 2 Normative references | | 3 |
| 3 Definitions | | 3 |
| 3.1 flange | | 3 |
| 3.2 DN (Nominal size) | | 3 |
| 3.3 PN | | 3 |
| 3.4 ductile iron | | 3 |
| 3.5 grey iron | | 3 |
| 3.6 malleable iron | | 3 |
| 3.7 joint | | 3 |
| 4 Designation and types | | 3 |
| 4.1 Range of DN | | 3 |
| 4.2 Range of PN designations | | 5 |
| 4.3 Types of flanges | | 5 |
| 4.4 Standard designation | | 5 |
| 4.5 Information to be supplied by the purchaser | | 5 |

| | | |
|--|------|----|
| 5 General requirements | Page | 5 |
| 5.1 Flange material | | 5 |
| 5.2 Repairs by welding | | 5 |
| 5.3 Bolting | | 5 |
| 5.4 Gaskets | | 5 |
| 5.5 Pressure/Temperature (p/T) ratings | | 5 |
| 5.6 Dimensions | | 6 |
| 5.7 Flange facings | | 6 |
| 5.8 Spot facing or back facing | | 6 |
| 5.9 Tolerances | | 6 |
| 5.10 Marking and stamping | | 6 |
| 5.11 Quality assurance | | 7 |
| Annex A (normative) Information to be supplied by the purchaser | | 28 |
| Annex B (informative) Notes to tables 6 to 12 | | 28 |
| Annex C (informative) Bibliography | | 28 |
| Tables | | |
| 1 Numerical values of the surface finish parameters (R_a and R_z) of flange jointing faces | | 6 |
| 2 Synoptic table for ductile iron flanges | | 8 |
| 3 Synoptic table for grey iron flanges | | 9 |
| 4 Synoptic table for malleable iron flanges | | 10 |
| 5 Dimensions for type B flange facings | | 11 |
| 6 Dimensions of PN 2,5 flanges | | 12 |
| 7 Dimensions of PN 6 flanges | | 14 |
| 8 Dimensions of PN 10 flanges | | 16 |
| 9 Dimensions of PN 16 flanges | | 18 |
| 10 Dimensions of PN 25 flanges | | 20 |
| 11 Dimensions of PN 40 flanges | | 22 |
| 12 Dimensions of PN 63 flanges | | 24 |
| 13 Tolerances on dimensions | | 25 |
| 14 Materials and assigned PN values | | 26 |
| 15 Pressure/temperature ratings for high strength ductile iron flanges | | 26 |
| 16 Pressure/temperature ratings for low strength ductile iron flanges | | 26 |
| 17 Pressure/temperature ratings for grey iron flanges | | 27 |
| 18 Pressure/temperature ratings for malleable iron flanges | | 27 |
| Figures | | |
| 1 Types of flanges | | 4 |
| 2 Flange facing types A and B | | 5 |
| 3 Dimensions of PN 2,5 flanges | | 12 |
| 4 Dimensions of PN 6 flanges | | 13 |
| 5 Dimensions of PN 10 flanges | | 15 |
| 6 Dimensions of PN 16 flanges | | 17 |
| 7 Dimensions of PN 25 flanges | | 19 |
| 8 Dimensions of PN 40 flanges | | 21 |
| 9 Dimensions of PN 63 flanges | | 23 |

Introduction

The product which is in permanent or temporary contact with water intended for human consumption does not adversely affect the quality of the drinking water and does not contravene the EC Directives and EFTA Regulations on the quality of drinking water.

1 Scope

This standard specifies requirements for circular flanges made from ductile, grey and malleable cast iron for DN 10 to DN 4000 and PN 2,5 to PN 63. (See 4.1 and 4.2).

This standard specifies the types of flanges and their facings, dimensions and tolerances, bolt sizes, surface finish of jointing faces, marking, testing, quality assurance and materials together with associated pressure/temperature (p/T) ratings.

2 Normative references

This European Standard incorporates by dated or undated reference, provisions from other publications. These normative references are cited at the appropriate places in the text and the publications are listed hereafter. For dated references, subsequent amendments to or revisions of any of these publications apply to this European Standard only when incorporated in it by amendment or revision. For undated references the latest edition of the publication referred to applies.

| | |
|--------------------|---|
| EN 545 | <i>Ductile iron pipes, fittings, accessories and their joints for water pipelines — Requirements and test methods</i> |
| prEN 1092-1 : 1994 | <i>Flanges and their joints — Circular flanges for pipes, valves, fittings and accessories, PN designated — Part 1: Steel flanges</i> |
| EN 1333 : 1996 | <i>Pipework components — Definition and selection of PN</i> |
| EN ISO 6708 : 1995 | <i>Pipework components — Definition and selection of DN (nominal size) (ISO 6708 : 1995)</i> |
| EN ISO 9002 : 1994 | <i>Quality systems — Model for quality assurance in production, installations and servicing (ISO 9002 : 1994)</i> |
| ISO 185 : 1988 | <i>Classification of grey cast iron</i> |
| ISO 468 : 1982 | <i>Surface roughness — Parameters, their values and general rules specifying requirements</i> |
| ISO 887 : 1983 | <i>Plain washers for metric bolts, screws and nuts — General plan</i> |
| ISO 2531 : 1991 | <i>Ductile iron pipes, fittings and accessories for pressure pipelines</i> |

| | |
|-------------------|--|
| ISO 2632-3 : 1979 | <i>Roughness comparison specimens</i> |
| ISO 5458 : 1987 | <i>Technical drawings — Geometrical tolerancing — Positional tolerancing</i> |
| ISO 5922 : 1981 | <i>Malleable cast iron</i> |
| ISO 7005-2 : 1988 | <i>Cast iron flanges</i> |

3 Definitions

For the purposes of this standard, the following definitions apply:

3.1 flange

Flat circular end of a pipe component extending perpendicular to its axis, with bolt holes equally spaced on a circle (see figure 1).

NOTE. A flange may be fixed (i.e. integrally cast, screwed or welded on) or adjustable; an adjustable flange comprises a ring, in one or several parts assembled together, which bears on an end joint hub and can be freely rotated around the pipe axis before jointing.

3.2 DN (nominal size)

See EN ISO 6708 : 1995.

NOTE. A numerical designation of size which is common to all components in a piping system. It is a convenient round-number for reference purposes and is only loosely related to manufacturing dimensions.

3.3 PN

See EN 1333 : 1996.

NOTE. A numerical designation of flanged components which is a convenient round-number for reference purposes. All components of the same nominal size DN designated by the same PN have compatible mating dimensions.

3.4 ductile iron

A cast iron in which graphite is present substantially in spheroidal form.

3.5 grey iron

A cast iron in which graphite is present substantially in lamellar form.

3.6 malleable iron

A cast iron in which graphite is present substantially in nodular form (temper carbon), and can be partially or wholly decarburized.

3.7 joint


A connection between the flanged ends of piping systems components in which a gasket is used to effect a seal.

4 Designation and types

4.1 Range of DN

DN 10 – DN 15 – DN 20 – DN 25 – DN 32 – DN 40 – DN 50 – DN 60 – DN 65 – DN 80 – DN 100 – DN 125 – DN 150 – DN 200 – DN 250 – DN 300 – DN 350 – DN 400 – DN 450 – DN 500 – DN 600 – DN 700 – DN 800 – DN 900 – DN 1000 – DN 1100 – DN 1200 – DN 1400 – DN 1500 – DN 1600 – DN 1800 – DN 2000 – DN 2200 – DN 2400 – DN 2600 – DN 2800 – DN 3000 – DN 3200 – DN 3400 – DN 3600 – DN 3800 – DN 4000.

The range of DN applicable to each flange type and to each PN shall be as specified in tables 2 to 4 as appropriate.

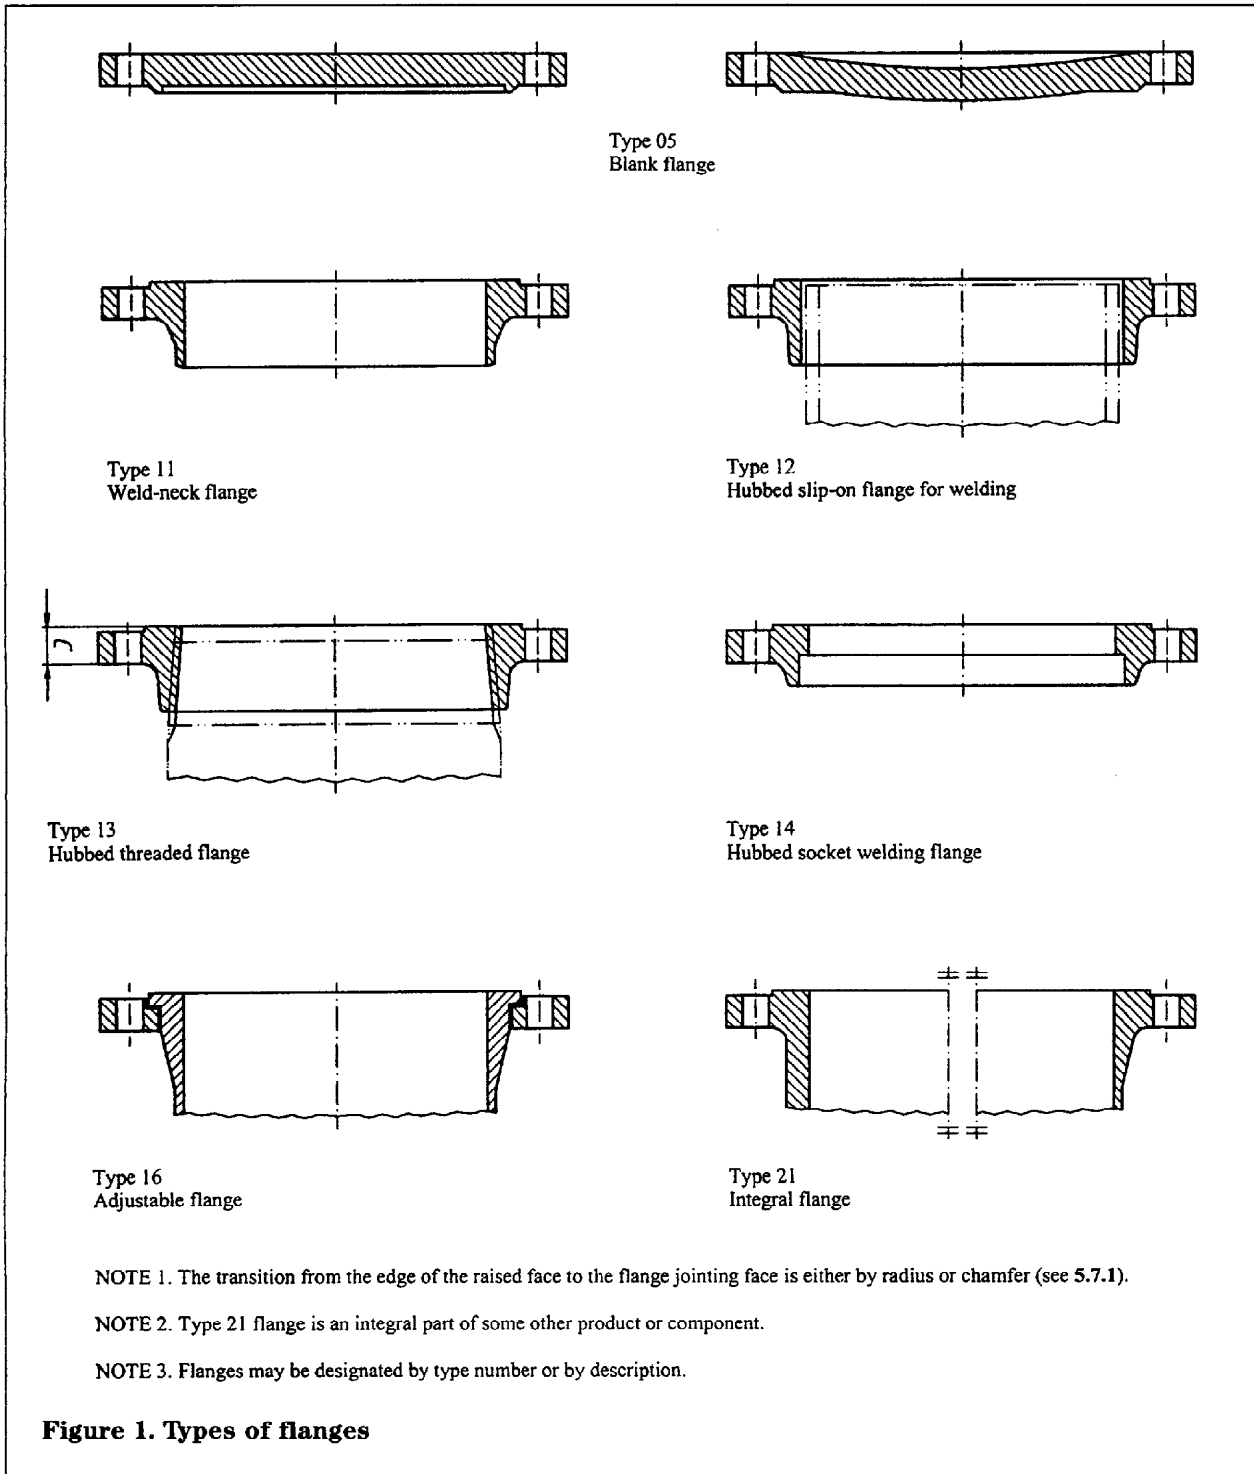

4.2 Range of PN designations

PN 2,5 – PN 6 – PN 10 – PN 16 – PN 25 – PN 40 – PN 63.

4.3 Types of flanges


Figure 1 illustrates flanges identified according to type:

- 05 : blank flange
- 11 : weld-neck flange
- 12 : hubbed slip-on flange for welding
- 13 : hubbed threaded flange
- 14 : hubbed socket welding flange
- 16 : adjustable flange
- 21 : integral flange

NOTE. By agreement between customer and manufacturer, an integral flange, modified as follows, can be supplied:

- a) bolt hole diameters and flange facing diameter in accordance with prEN 1092-1;
 - b) for ductile iron, flange thickness to be as grey iron flanges.
- Such flanges shall be designated as type 21-2.

Figure 2 illustrates facing types A and B, which are used where applicable in conjunction with flanges shown in figure 1 (see 5.7.1).

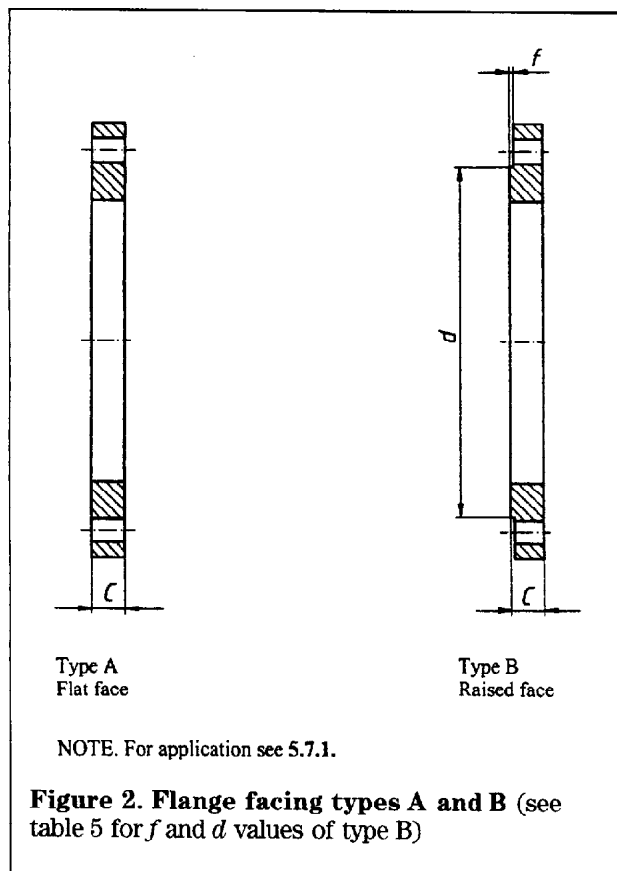

4.4 Standard designation

Flanges conforming to this standard shall be designated as follows:

- a) term: flange;
- b) number of this standard: EN 1092-2;
- c) DN (see 4.1);
- d) PN (see 4.2);
- e) number of flange type (see 4.3);
- f) material type and grade (see 5.1);
- g) flange facing type for malleable cast iron (see 5.7.1).

Example:

Designation of a weld-neck flange DN 100, PN 40, type 11, material type MI and grade B30-06 and facing type A:

Flange EN 1092-2/DN100/PN40/11/FM B30-06/A

4.5 Information to be supplied by the purchaser

The information to be supplied by the purchaser shall be as given in annex A.

5 General requirements

5.1 Flange materials

Flanges shall be manufactured from the materials specified in table 14.

5.2 Repairs by welding

Where not otherwise prohibited by the applicable material standard, repairs by welding are permitted when there is a proven method. All welding shall be carried out in accordance with a written procedure.

5.3 Bolting

The bolting shall be chosen by the user according to the pressure, temperature, flange material and gasket. For joints comprising at least one grey iron flange it is recommended that bolting having a yield strength not exceeding 240 N/mm² should be used.

5.4 Gaskets

The gaskets are not within the scope of this standard. For information on types, dimensions and types of gaskets see EN 1514.

5.5 Pressure/temperature (p/T) ratings

5.5.1 General

The pressure/temperature ratings of the flanges manufactured from the materials specified in table 14 shall be the allowable non- shock pressures at the temperatures given in tables 15 and 16 (ductile iron), 17 (grey iron) and 18 (malleable iron). Linear interpolation is permitted for intermediate temperatures.

NOTE. The p/T rating of a flange is not necessarily the p/T rating of the whole pipework system. Gasket materials can also impose limitation on the p/T rating of a flanged joint and the gasket manufacturer should be consulted when selecting the material of the gasket.

5.5.2 p/T rating of flanged joints

Where two flanges in a flanged joint do not have the same p/T rating, the p/T rating of the joint at any temperature shall not exceed the lower of the two flange ratings at that temperature.

NOTE 1. The temperature is that of the contained fluid. Use of a temperature other than that of the contained fluid is the responsibility of the user, subject to the requirements of any applicable code or regulation.

NOTE 2. Application of the p/T ratings given in this standard to flange joints, should take into consideration the risk of leakage due to forces and moments developed in the connecting pipework.

NOTE 3. Owing to the nature of any thread sealing method used, additional limitations can be placed on a threaded flange.

NOTE 4. These notes on service considerations are not intended to be exhaustive.

5.6 Dimensions

Dimensions of flanges shall be in accordance with the following tables and figures as appropriate:

- PN 2,5 flanges: table 6 and figure 3;
- PN 6 flanges: table 7 and figure 4;
- PN 10 flanges: table 8 and figure 5;
- PN 16 flanges: table 9 and figure 6;
- PN 25 flanges: table 10 and figure 7;
- PN 40 flanges: table 11 and figure 8;
- PN 63 flanges: table 12 and figure 9.

NOTE 1. Dimensions which are not given in this standard are determined by the manufacturer for his design of flange.

NOTE 2. Details of attachment for welded, threaded and adjustable flanges are not within the scope of this standard.

5.7 Flange facings

5.7.1 Types of facings

The flange facings specified (flat face type A and raised face type B) are illustrated in figure 2 and their raised face dimensions shall be as given in table 5.

Flanges made of ductile iron shall have raised faces;

Flanges made of grey iron shall have raised faces.

See 5.3 for the limitations on bolting due to this material.

Flanges made of malleable iron shall have either flat faces or raised faces.

NOTE. The transition from the outside diameter of the raised face to the flange face is at the option of the manufacturer (i.e. either a radius or chamfer may be used).

5.7.2 Jointing face finish

All flange jointing faces shall be finished in accordance with table 1. These faces shall be compared by visual or tactile means with reference specimens which conform with the R_a and R_z roughness values given in table 1.

NOTE 1. It is not intended that instrument measurements are taken on the flange jointing faces: the R_a and R_z values as defined in ISO 468 : 1982 relate to the reference specimens.

NOTE 2. Other finishes may be agreed between the manufacturer and purchaser.

Table 1. Numerical values of the surface finish parameters (R_a and R_z) of flange jointing faces

| Values in micrometres | | |
|---|-------------|------------|
| Manufacturing process | R_a | R_z |
| Turning ¹⁾ | 3,2 to 12,5 | 12,5 to 50 |
| Other machining processes ²⁾ | 3,2 to 6,3 | 12,5 to 25 |
| As cast ³⁾ | 3,2 to 25 | — |

¹⁾ 'Turning' covers any method of machine operation producing either serrated concentric or serrated spiral grooves.
²⁾ Machining processes other than turning are permissible provided that they give a surface finish in compliance with the R_a and R_z values specified.
³⁾ 'As cast' covers surfaces produced by moulding processes where the resultant casting may or may not be subjected to shot or grit blast cleaning operations. Their roughness is assessed by comparison with reference specimens complying with ISO 2632-3 : 1979. As cast surfaces may have serrated concentric grooves to enhance gasket sealing efficiency. They are normally used for application where joints incorporate gaskets of readily deformable material, e.g. rubber, application for which the above surface characteristics may also apply to the other manufacturing processes.

5.8 Spot facing or back facing

Any spot facing or back facing required shall not reduce the flange thickness to less than the thickness specified. When spot facing is used, the diameter shall be large enough to accommodate the outside diameter of the equivalent normal series of washers complying with ISO 887 : 1983 for the bolt size being fitted. When a flange is back faced, it is permissible for the fillet radius to be reduced but it shall not be eliminated entirely. The bearing surfaces for the bolting shall be parallel to the flange face within 2°.

5.9 Tolerances

The tolerances or dimensions are as specified in table 13.

5.10 Marking and stamping

5.10.1 Marking

Blank flanges and flanges which are supplied not attached to pipeline components shall be marked as follows:

- a) DN (nominal size);
- b) PN designation;
- c) material identification;
- d) manufacturer's name or trade-mark.

Example: DN 300 PN 16 420-5 XXXX

NOTE. Where a flange is subsequently used to form an integral part of a component and the component has a lower pressure rating than that of the flange, the lower rating should be clearly marked on the component and the lower p/T rating applies.

5.10.2 Stamping

Where steel stamps are used, the marking shall be positioned on the rim of the flange. Low stress round nose stamps shall be used.

5.10.3 Omission of markings

If a flange is too small to enable all the markings required in 5.10.1 to be marked on the flange, then marking of nominal size may be omitted.

5.11 Quality assurance**5.11.1 General**

The following quality assurance requirement applies to all types of flanges except for those delivered attached to a pipeline component. The quality assurance requirements for those flanges are given in the appropriate component standards.

5.11.2 Quality assurance system

The manufacturer shall operate a quality assurance system in accordance with EN ISO 9002 : 1994.




Table 2. Synoptic table for ductile iron flanges

| Type No | Table | DN | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|---------|-------|----|--|----|----|----|----|----|----|----|----|----|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|--|--|--|--|--|--|--|--|--|--|--|--|
| | | PN | | 10 | 15 | 20 | 25 | 32 | 40 | 50 | 60 | 65 | 80 | 100 | 125 | 150 | 200 | 250 | 300 | 350 | 400 | 450 | 500 | 600 | 700 | 800 | 900 | 1000 | 1100 | 1200 | 1400 | 1500 | 1600 | 1800 | 2000 | 2200 | 2400 | 2600 | 2800 | 3000 | 3200 | 3400 | 3600 | 3800 | 4000 | | | | | | | | | | | | |
| 05 | 8 | 10 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 9 | 16 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 10 | 25 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 11 | 40 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 12 | 63 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 11 | 8 | 10 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 9 | 16 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 10 | 25 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 11 | 40 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 12 | 63 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12 | 8 | 10 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 9 | 16 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 10 | 25 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 11 | 40 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 12 | 63 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 13 | 8 | 10 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 9 | 16 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 10 | 25 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 11 | 40 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 12 | 63 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 14 | 8 | 10 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 9 | 16 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 10 | 25 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 11 | 40 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 12 | 63 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 16 | 8 | 10 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 9 | 16 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 10 | 25 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 11 | 40 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 12 | 63 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 21 | 8 | 10 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 9 | 16 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 10 | 25 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 11 | 40 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | 12 | 63 | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

NOTE 1. A horizontal line of 'X' indicates the range DN in which flanges of a particular type and PN may be ordered to this standard.

NOTE 2. Type 21-2 flanges are possible by agreement between manufacturer and purchaser (see notes to tables 6 and 7).

¹⁾ DN 10 to 32 is limited to type 21-2.



S

Table 3. Synoptic table for grey iron flanges

| Type No | Table | DN \ PN | DN | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|---------|-------|---------|----|----|----|----|----|----|----|----|----|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|------|---|---|---|---|---|---|
| | | | 10 | 15 | 20 | 25 | 32 | 40 | 50 | 60 | 65 | 80 | 100 | 125 | 150 | 200 | 250 | 300 | 350 | 400 | 450 | 500 | 600 | 700 | 800 | 900 | 1000 | 1100 | 1200 | 1400 | 1500 | 1600 | 1800 | 2000 | 2200 | 2400 | 2600 | 2800 | 3000 | 3200 | 3400 | 3600 | 3800 | 4000 | | | | | | |
| 05 | 6 | 2,5 | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | | | | |
| | 7 | 6 | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | | |
| | 8 | 10 | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | | |
| | 9 | 16 | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | | |
| | 10 | 25 | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | | |
| | 11 | 40 | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | | |
| | 6 | 2,5 | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | | |
| | 7 | 6 | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | |
| | 8 | 10 | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | |
| | 9 | 16 | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | |
| | 10 | 25 | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - |
| 11 | 40 | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | - | |
| 21 | 6 | 2,5 | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | |
| | 7 | 6 | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X |
| | 8 | 10 | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X |
| | 9 | 16 | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X |
| | 10 | 25 | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X | X |

NOTE. A horizontal line of 'X' indicates the range of DN in which flanges of a particular type and PN may be ordered to this standard.

Table 5. Dimensions for type B flange facings (see figure 2)

| Dimensions in millimetres | | | | | | | | |
|---------------------------|---|--------|------|-------|-------|-------|-------|-------|
| DN | f | d | | | | | | |
| | | PN 2,5 | PN 6 | PN 10 | PN 16 | PN 25 | PN 40 | PN 63 |
| 10 | 2 | 33 | 33 | 41 | 41 | 41 | 41 | — |
| 15 | 2 | 38 | 38 | 46 | 46 | 46 | 46 | — |
| 20 | 2 | 48 | 48 | 56 | 56 | 56 | 56 | — |
| 25 | 3 | 58 | 58 | 65 | 65 | 65 | 65 | — |
| 32 | 3 | 69 | 69 | 76 | 76 | 76 | 76 | — |
| 40 | 3 | 78 | 78 | 84 | 84 | 84 | 84 | 84 |
| 50 | 3 | 88 | 88 | 99 | 99 | 99 | 99 | 99 |
| 60 | 3 | 98 | 98 | 108 | 108 | 108 | 108 | 108 |
| 65 | 3 | 108 | 108 | 118 | 118 | 118 | 118 | 118 |
| 80 | 3 | 124 | 124 | 132 | 132 | 132 | 132 | 132 |
| 100 | 3 | 144 | 144 | 156 | 156 | 156 | 156 | 156 |
| 125 | 3 | 174 | 174 | 184 | 184 | 184 | 184 | 184 |
| 150 | 3 | 199 | 199 | 211 | 211 | 211 | 211 | 211 |
| 200 | 3 | 254 | 254 | 266 | 266 | 274 | 284 | 284 |
| 250 | 3 | 309 | 309 | 319 | 319 | 330 | 345 | 345 |
| 300 | 4 | 363 | 363 | 370 | 370 | 389 | 409 | 409 |
| 350 | 4 | 413 | 413 | 429 | 429 | 448 | 465 | 465 |
| 400 | 4 | 463 | 463 | 480 | 480 | 503 | 535 | 535 |
| 450 | 4 | 518 | 518 | 530 | 548 | 548 | 560 | — |
| 500 | 4 | 568 | 568 | 582 | 609 | 609 | 615 | — |
| 600 | 5 | 667 | 667 | 682 | 720 | 720 | 735 | — |
| 700 | 5 | 772 | 772 | 794 | 794 | 820 | — | — |
| 800 | 5 | 878 | 878 | 901 | 901 | 928 | — | — |
| 900 | 5 | 978 | 978 | 1001 | 1001 | 1028 | — | — |
| 1000 | 5 | 1078 | 1078 | 1112 | 1112 | 1140 | — | — |
| 1100 | 5 | — | — | 1218 | 1218 | 1240 | — | — |
| 1200 | 5 | 1280 | 1295 | 1328 | 1328 | 1350 | — | — |
| 1400 | 5 | 1480 | 1510 | 1530 | 1530 | 1560 | — | — |
| 1500 | 5 | — | — | 1640 | 1640 | 1678 | — | — |
| 1600 | 5 | 1690 | 1710 | 1750 | 1750 | 1780 | — | — |
| 1800 | 5 | 1890 | 1918 | 1950 | 1950 | 1985 | — | — |
| 2000 | 5 | 2090 | 2125 | 2150 | 2150 | 2210 | — | — |
| 2200 | 6 | 2295 | 2335 | — | — | — | — | — |
| 2400 | 6 | 2495 | 2545 | — | — | — | — | — |
| 2600 | 6 | 2695 | 2750 | — | — | — | — | — |
| 2800 | 6 | 2910 | 2960 | — | — | — | — | — |
| 3000 | 6 | 3110 | 3160 | — | — | — | — | — |
| 3200 | 6 | 3310 | 3370 | — | — | — | — | — |
| 3400 | 6 | 3510 | 3580 | — | — | — | — | — |
| 3600 | 6 | 3720 | 3790 | — | — | — | — | — |
| 3800 | 6 | 3920 | — | — | — | — | — | — |
| 4000 | 6 | 4120 | — | — | — | — | — | — |

NOTE. For flanges type 16, d of PN 10 applies for PN 10 to 40 and d of DN 65 is the same as DN 60.



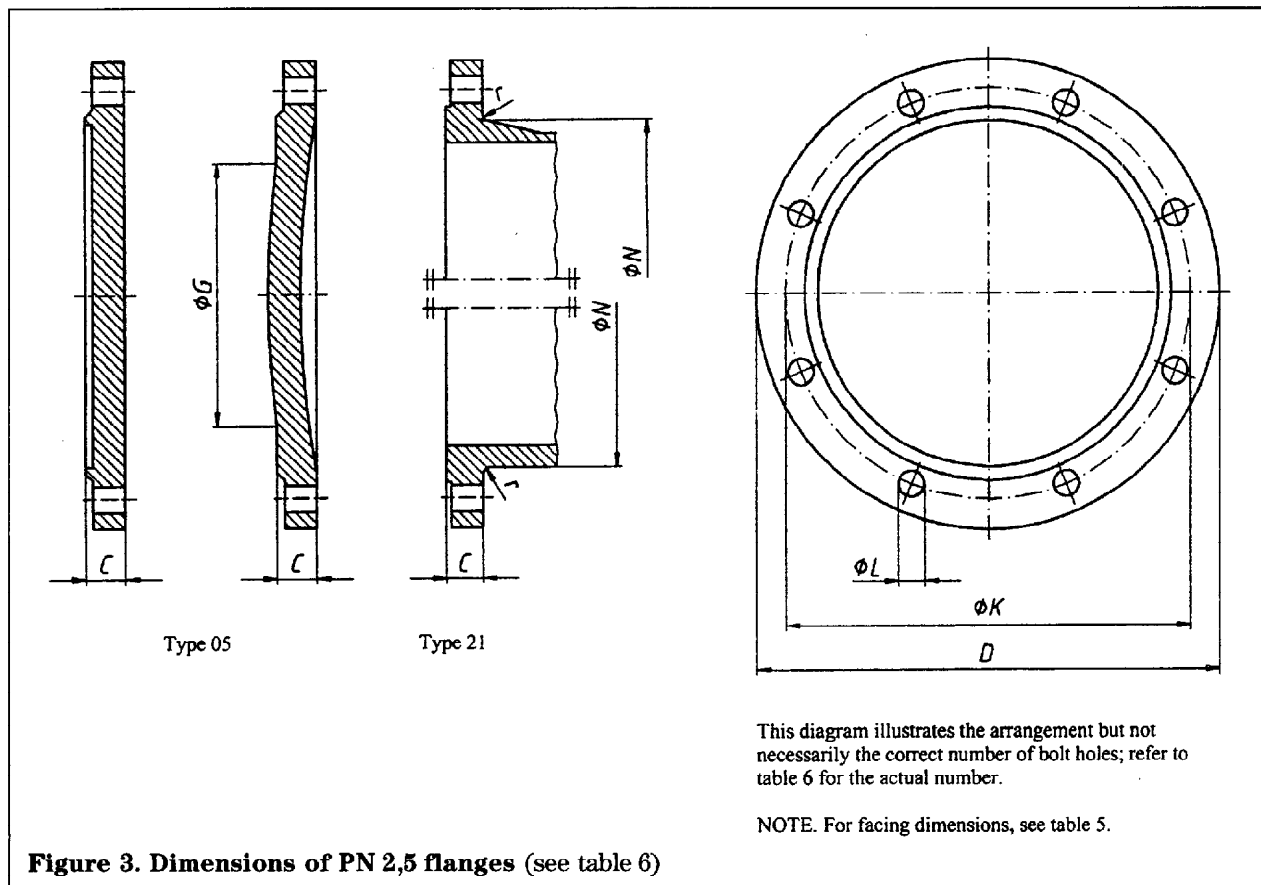




Figure 3. Dimensions of PN 2,5 flanges (see table 6)

Table 6. Dimensions of PN 2,5 flanges (see figure 3 and annex B)

| Dimensions in millimetres | | | | | | | | | |
|---------------------------|---------------------------------|------------------------------|----------------------------|---------------------------------|-----|---|-----------------------------------|--------------------|-------------------|
| DN | Mating dimensions | | | | | Flange thickness GI ¹⁾²⁾ C | Maximum diameter of shoulder G | Neck diameter N | Corner radii r |
| | Outside diameter of flange D | Diameter of bolt circle K | Diameter of bolt hole L | Bolts Number Nominal size | | | | | |
| Flange type | | | | | | | | | |
| 05/21 | | | | | | 05/21 | 05 | 21 | 21 |
| 10 to 1000 | Use PN6 | | | | | | | | |
| 1200 | 1375 | 1320 | 31 | 32 | M27 | 30 | 1185 | 1250 | 8 |
| 1400 | 1575 | 1520 | 31 | 36 | M27 | 30 | 1385 | 1452 | 8 |
| 1600 | 1790 | 1730 | 31 | 40 | M27 | 32 | 1585 | 1654 | 10 |
| 1800 | 1990 | 1930 | 31 | 44 | M27 | 34 | 1785 | 1856 | 10 |
| 2000 | 2190 | 2130 | 31 | 48 | M27 | 34 | 1985 | 2056 | 10 |
| 2200 | 2405 | 2340 | 34 | 52 | M30 | 36 | 2185 | 2260 | 10 |
| 2400 | 2605 | 2540 | 34 | 56 | M30 | 38 | 2385 | 2464 | 10 |
| 2600 | 2805 | 2740 | 34 | 60 | M30 | 40 | 2585 | 2668 | 10 |
| 2800 | 3030 | 2960 | 37 | 64 | M33 | 42 | 2785 | 2868 | 12 |
| 3000 | 3230 | 3160 | 37 | 68 | M33 | 42 | 2985 | 3068 | 12 |
| 3200 | 3430 | 3360 | 37 | 72 | M33 | 44 | 3185 | 3268 | 12 |
| 3400 | 3630 | 3560 | 37 | 76 | M33 | 46 | 3385 | 3472 | 12 |
| 3600 | 3840 | 3770 | 37 | 80 | M33 | 48 | 3585 | 3676 | 12 |
| 3800 | 4045 | 3970 | 41 | 80 | M36 | 48 | 3785 | 3876 | 12 |
| 4000 | 4245 | 4170 | 41 | 84 | M36 | 50 | 3985 | 4076 | 12 |

¹⁾ See table 14 for an explanation of the abbreviated iron designations.

²⁾ These flange thicknesses are also valid for ductile iron flanges type 21-2.

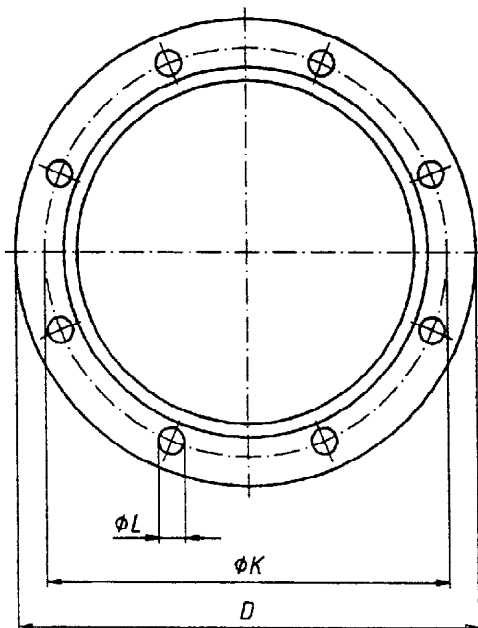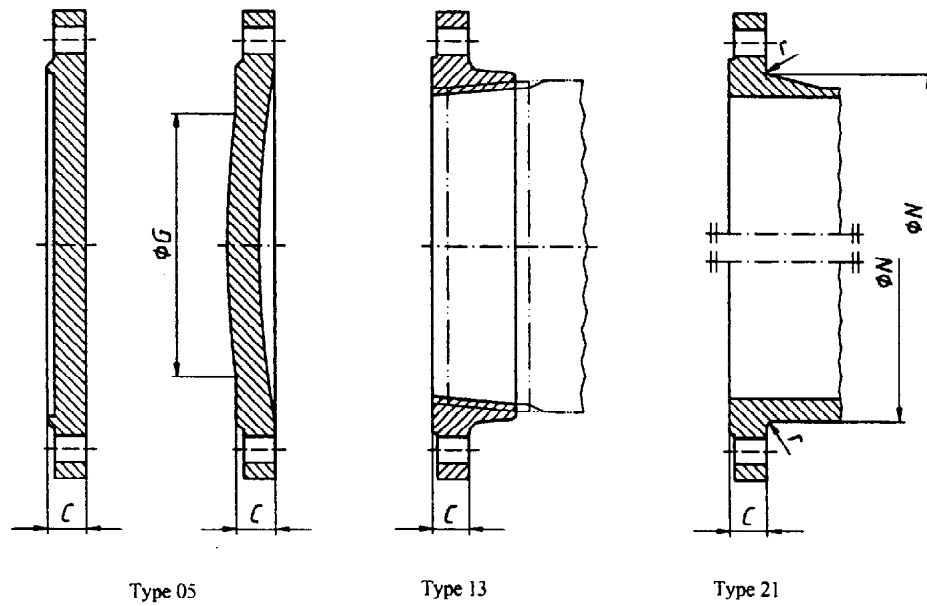

This diagram illustrates the arrangement but not necessarily the correct number of bolt holes; refer to table 7 for the actual number.


NOTE. For facing dimensions, see table 5.

Figure 4. Dimensions of PN 6 flanges (see table 7)

S

| Table 7. Dimensions of PN 6 flanges (see figure 4 and annex B) | | | | | | | | | | |
|--|--|-------------------------------------|-----------------------------------|--------|--------------|--------------------------------|------------------------------|--|---------------------------|--------------------------|
| Dimensions in millimetres | | | | | | | | | | |
| DN | Mating dimensions | | | | | Flange thickness | | Maximum diameter of shoulder <i>G</i> | Neck diameter <i>N</i> | Corner radii <i>r</i> |
| | Outside diameter of flange <i>D</i> | Diameter of bolt circle <i>K</i> | Diameter of bolt hole <i>L</i> | Bolts | | GI ¹⁾²⁾ <i>C</i> | MI ¹⁾ <i>C</i> | | | |
| | | | | Number | Nominal size | | | | | |
| Flange type | | | | | | | | | | |
| 13/05/21 | | | | | | 05/21 | 13/05/21 | 05 | 13/21 | 13/21 |
| 10 | 75 | 50 | 11 | 4 | M10 | 12 | 12 | — | 20 | 3 |
| 15 | 80 | 55 | 11 | 4 | M10 | 12 | 12 | — | 26 | 3 |
| 20 | 90 | 65 | 11 | 4 | M10 | 14 | 14 | — | 34 | 4 |
| 25 | 100 | 75 | 11 | 4 | M10 | 14 | 14 | — | 44 | 4 |
| 32 | 120 | 90 | 14 | 4 | M12 | 16 | 16 | — | 54 | 5 |
| 40 | 130 | 100 | 14 | 4 | M12 | 16 | 16 | — | 64 | 5 |
| 50 | 140 | 110 | 14 | 4 | M12 | 16 | 16 | — | 74 | 5 |
| 60 | 150 | 120 | 14 | 4 | M12 | 16 | 16 | — | 84 | 6 |
| 65 | 160 | 130 | 14 | 4 | M12 | 16 | 16 | — | 94 | 6 |
| 80 | 190 | 150 | 19 | 4 | M16 | 18 | 18 | — | 110 | 6 |
| 100 | 210 | 170 | 19 | 4 | M16 | 18 | 18 | — | 130 | 6 |
| 125 | 240 | 200 | 19 | 8 | M16 | 20 | 20 | — | 160 | 6 |
| 150 | 265 | 225 | 19 | 8 | M16 | 20 | 20 | — | 182 | 8 |
| 200 | 320 | 280 | 19 | 8 | M16 | 22 | 22 | — | 238 | 8 |
| 250 | 375 | 335 | 19 | 12 | M16 | 24 | 24 | — | 284 | 10 |
| 300 | 440 | 395 | 23 | 12 | M20 | 24 | 24 | — | 342 | 10 |
| 350 | 490 | 445 | 23 | 12 | M20 | 26 | — | 335 | 392 | 10 |
| 400 | 540 | 495 | 23 | 16 | M20 | 28 | — | 385 | 442 | 10 |
| 450 | 595 | 550 | 23 | 16 | M20 | 28 | — | 435 | 494 | 12 |
| 500 | 645 | 600 | 23 | 20 | M20 | 30 | — | 485 | 544 | 12 |
| 600 | 755 | 705 | 28 | 20 | M24 | 30 | — | 585 | 642 | 12 |
| 700 | 860 | 810 | 28 | 24 | M24 | 32 | — | 685 | 746 | 12 |
| 800 | 975 | 920 | 31 | 24 | M27 | 34 | — | 785 | 850 | 12 |
| 900 | 1075 | 1020 | 31 | 24 | M27 | 36 | — | 885 | 950 | 12 |
| 1000 | 1175 | 1120 | 31 | 28 | M27 | 36 | — | 985 | 1050 | 12 |
| 1200 | 1405 | 1340 | 34 | 32 | M30 | 40 | — | 1185 | 1264 | 12 |
| 1400 | 1630 | 1560 | 37 | 36 | M33 | 44 | — | 1385 | 1480 | 12 |
| 1600 | 1830 | 1760 | 37 | 40 | M33 | 48 | — | 1585 | 1680 | 12 |
| 1800 | 2045 | 1970 | 41 | 44 | M36 | 50 | — | 1785 | 1878 | 15 |
| 2000 | 2265 | 2180 | 44 | 48 | M39 | 54 | — | 1985 | 2082 | 15 |
| 2200 | 2475 | 2390 | 44 | 52 | M39 | 60 | — | — | 3) | 15 |
| 2400 | 2685 | 2600 | 44 | 56 | M39 | 62 | — | — | 3) | 15 |
| 2600 | 2905 | 2810 | 50 | 60 | M45 | 64 | — | — | 3) | 15 |
| 2800 | 3115 | 3020 | 50 | 64 | M45 | 68 | — | — | 3) | 15 |
| 3000 | 3315 | 3220 | 50 | 68 | M45 | 70 | — | — | 3) | 15 |
| 3200 | 3525 | 3430 | 50 | 72 | M45 | 76 | — | — | 3) | 15 |
| 3400 | 3735 | 3640 | 50 | 76 | M45 | 80 | — | — | 3) | 15 |
| 3600 | 3970 | 3860 | 57 | 80 | M52 | 84 | — | — | 3) | 15 |


1) See table 14 for an explanation of the abbreviated iron designations.
2) These flange thicknesses are also valid for ductile iron flanges type 21-2.
3) Manufacturer's option.

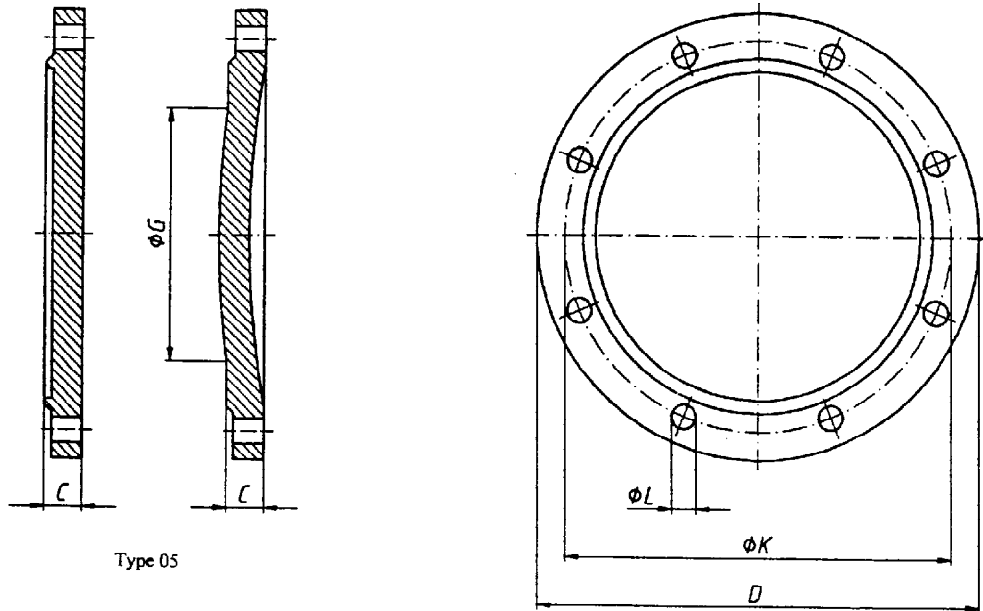

Type 05

This diagram illustrates the arrangement but not necessarily the correct number of bolt holes; refer to table 8 for the actual number.

NOTE. For facing dimensions, see table 5.

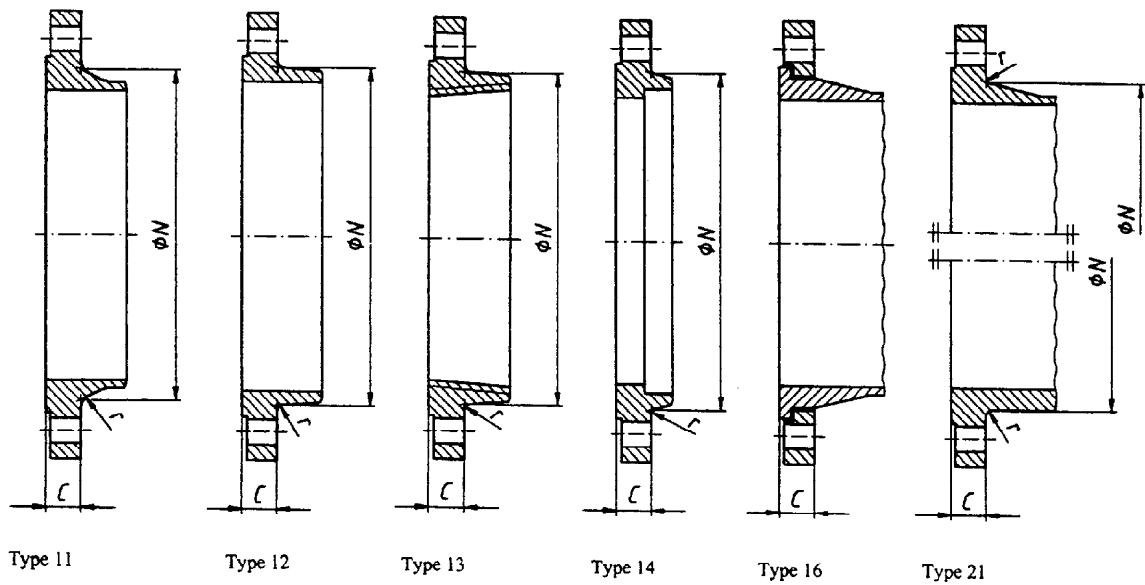

Type 11

Type 12

Type 13

Type 14

Type 16

Type 21

Figure 5. Dimensions of PN 10 flanges (see table 8)

* S *

| Table 8. Dimensions of PN 10 flanges (see figure 5 and annex B) | | | | | | | | | | | | |
|---|--|-------------------------------------|-----------------------------------|--------|--------------|--------------------------------|--------------------------------|------------------------------|--|---------------------------|--------------------------|----------------------|
| Dimensions in millimetres | | | | | | | | | | | | |
| DN | Mating dimensions | | | | | Flange thickness | | | Maximum diameter of shoulder <i>G</i> | Neck diameter <i>N</i> | Corner radii <i>r</i> | |
| | Outside diameter of flange <i>D</i> | Diameter of bolt circle <i>K</i> | Diameter of bolt hole <i>L</i> | Bolts | | DI ¹⁾³⁾ <i>C</i> | GI ¹⁾⁴⁾ <i>C</i> | MI ¹⁾ <i>C</i> | | | | |
| | | | | Number | Nominal size | | | | | | | |
| Flange type | | | | | | | | | | | | |
| 05/11/12/13/14/16/21 | | | | | | 05/11 12/13 14/21 | 16 | 05/13 21 | 05/13 21 | 05 | 11/12 13/14 21 | 11/12 13/14 21 |
| 10 | Use PN 16 dimensions | | | | | | | | | | | |
| 15 | | | | | | | | | | | | |
| 20 | | | | | | | | | | | | |
| 25 | | | | | | | | | | | | |
| 32 | | | | | | | | | | | | |
| 40 | | | | | | | | | | | | |
| 50 | | | | | | | | | | | | |
| 60 | | | | | | | | | | | | |
| 65 | | | | | | | | | | | | |
| 80 | | | | | | | | | | | | |
| 100 | 340 | 295 | 23 | 8 | M20 | 20 | 29 | 26 | 24 | — | 246 | 8 |
| 250 | 395 ²⁾ | 350 | 23 | 12 | M20 | 22 | 32 | 28 | 26 | — | 298 | 10 |
| 300 | 445 ²⁾ | 400 | 23 | 12 | M20 | 24,5 | 36 | 28 | 26 | — | 348 | 10 |
| 350 | 505 | 460 | 23 | 16 | M20 | 24,5 | 39 | 30 | — | 335 | 408 | 10 |
| 400 | 565 | 515 | 28 | 16 | M24 | 24,5 | 42 | 32 | — | 385 | 456 | 10 |
| 450 | 615 | 565 | 28 | 20 | M24 | 25,5 | 45 | 32 | — | 435 | 502 | 12 |
| 500 | 670 | 620 | 28 | 20 | M24 | 26,5 | 48 | 34 | — | 485 | 559 | 12 |
| 600 | 780 | 725 | 31 | 20 | M27 | 30 | 55 | 36 | — | 585 | 658 | 12 |
| 700 | 895 | 840 | 31 | 24 | M27 | 32,5 | — | 40 | — | 685 | 772 | 12 |
| 800 | 1015 | 950 | 34 | 24 | M30 | 35 | — | 44 | — | 785 | 876 | 12 |
| 900 | 1115 | 1050 | 34 | 28 | M30 | 37,5 | — | 46 | — | 885 | 976 | 12 |
| 1000 | 1230 | 1160 | 37 | 28 | M33 | 40 | — | 50 | — | 985 | 1080 | 12 |
| 1100 | 1340 | 1270 | 37 | 32 | M33 | 42,5 | — | 53 | — | 1085 | 1186 | 12 |
| 1200 | 1455 | 1380 | 41 | 32 | M36 | 45 | — | 56 | — | 1185 | 1292 | 12 |
| 1400 | 1675 | 1590 | 44 | 36 | M39 | 46 | — | 62 | — | 1385 | 1496 | 12 |
| 1500 | 1785 | 1700 | 44 | 36 | M39 | 47,5 | — | 65 | — | 1485 | 1605 | 12 |
| 1600 | 1915 | 1820 | 50 | 40 | M45 | 49 | — | 68 | — | 1585 | 1712 | 12 |
| 1800 | 2115 | 2020 | 50 | 44 | M45 | 52 | — | 70 | — | 1785 | 1910 | 15 |
| 2000 | 2325 | 2230 | 50 | 48 | M45 | 55 | — | 74 | — | 1985 | 2120 | 15 |

¹⁾ See table 14 for an explanation of the abbreviated iron designations.
²⁾ For ductile iron pipes and fittings the outside diameters for the following flanges shall be:
 - for DN 250 *D* = 400 mm
 - for DN 300 *D* = 455 mm.
³⁾ PN 10 ductile iron flanges may be used on socket pipelines up to pressures of approximately 15 bar.
⁴⁾ These flange thicknesses are also valid for ductile iron flanges type 21-2.


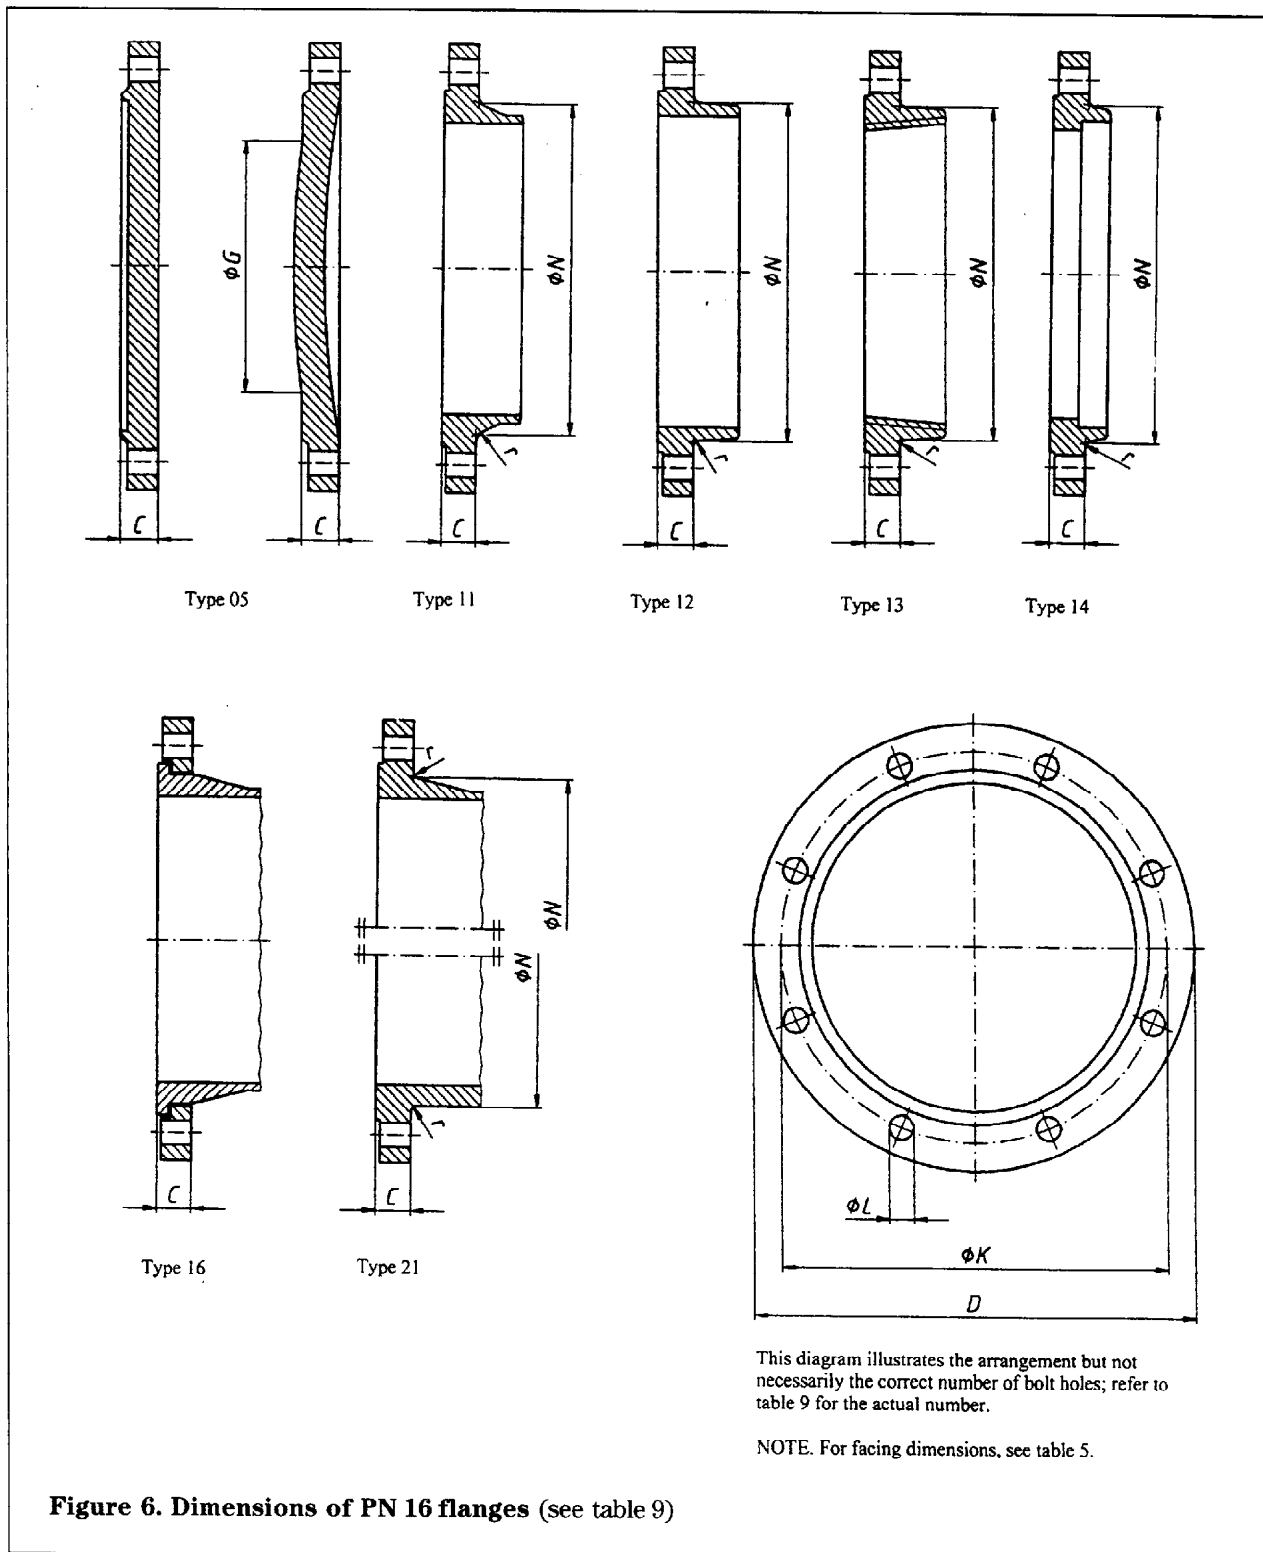


Table 9. Dimensions of PN 16 flanges (see figure 6 and annex B)

| Dimensions in millimetres | | | | | | | | | | | | |
|---------------------------|--|-------------------------------------|-----------------------------------|-----------------|--------------|--------------------------------|--------------------------------|------------------------------|--|---------------------------|--------------------------|----------------------|
| DN | Mating dimensions | | | | | Flange thickness | | | Maximum diameter of shoulder <i>G</i> | Neck diameter <i>N</i> | Corner radii <i>r</i> | |
| | Outside diameter of flange <i>D</i> | Diameter of bolt circle <i>K</i> | Diameter of bolt hole <i>L</i> | Bolts | | DI ¹⁾²⁾ <i>C</i> | GI ¹⁾³⁾ <i>C</i> | MI ¹⁾ <i>C</i> | | | | |
| | | | | Number | Nominal size | | | | | | | |
| Flange type | | | | | | | | | | | | |
| 05/11/12/13/14/16/21 | | | | | | 05/11 12/13 14/21 | 16 | 05/13 21 | 05/13 21 | 05 | 11/12 13/14 21 | 11/12 13/14 21 |
| 10 | Use PN 40 dimensions | | | | | 14 | — | 14 | 14 | — | 28 | 3 |
| 15 | | | | | | 14 | — | 14 | 14 | — | 32 | 3 |
| 20 | | | | | | 16 | — | 16 | 16 | — | 40 | 4 |
| 25 | | | | | | 16 | — | 16 | 16 | — | 50 | 4 |
| 32 | | | | | | 18 | — | 18 | 18 | — | 60 | 5 |
| 40 | | | | | | 19 | 22 | 18 | 18 | — | 70 | 5 |
| 50 | 19 | 22 | 20 | 20 | — | 84 | 5 | | | | | |
| 60 | 175 | 135 | 19 | 4 | M16 | 19 | 22 | 20 | 20 | — | 94 | 6 |
| 65 | 185 | 145 | 19 | 4 ⁴⁾ | M16 | 19 | 22 | 20 | 20 | — | 104 | 6 |
| 80 | 200 | 160 | 19 | 8 | M16 | 19 | 22 | 22 | 20 | — | 120 | 6 |
| 100 | 220 | 180 | 19 | 8 | M16 | 19 | 23 | 24 | 22 | — | 140 | 6 |
| 125 | 250 | 210 | 19 | 8 | M16 | 19 | 24,5 | 26 | 22 | — | 170 | 6 |
| 150 | 285 | 240 | 23 | 8 | M20 | 19 | 26 | 26 | 24 | — | 190 | 8 |
| 200 | 340 | 295 | 23 | 12 | M20 | 20 | 29 | 30 | 24 | — | 246 | 8 |
| 250 | 405 ²⁾ | 355 | 28 | 12 | M24 | 22 | 32 | 32 | 26 | — | 296 | 10 |
| 300 | 460 ²⁾ | 410 | 28 | 12 | M24 | 24,5 | 36 | 32 | 28 | — | 350 | 10 |
| 350 | 520 | 470 | 28 | 16 | M24 | 26,5 | 39 | 36 | — | 335 | 410 | 10 |
| 400 | 580 | 525 | 31 | 16 | M27 | 28 | 42 | 38 | — | 385 | 458 | 10 |
| 450 | 640 | 585 | 31 | 20 | M27 | 30 | 45 | 40 | — | 435 | 516 | 12 |
| 500 | 715 | 650 | 34 | 20 | M30 | 31,5 | 48 | 42 | — | 485 | 576 | 12 |
| 600 | 840 | 770 | 37 | 20 | M33 | 36 | 55 | 48 | — | 585 | 690 | 12 |
| 700 | 910 | 840 | 37 | 24 | M33 | 39,5 | — | 54 | — | 685 | 760 | 12 |
| 800 | 1025 | 950 | 41 | 24 | M36 | 43 | — | 58 | — | 785 | 862 | 12 |
| 900 | 1125 | 1050 | 41 | 28 | M36 | 46,5 | — | 62 | — | 885 | 962 | 12 |
| 1000 | 1255 | 1170 | 44 | 28 | M39 | 50 | — | 66 | — | 985 | 1076 | 12 |
| 1100 | 1355 | 1270 | 44 | 32 | M39 | 53,5 | — | — | — | 1085 | 1176 | 12 |
| 1200 | 1485 | 1390 | 50 | 32 | M45 | 57 | — | — | — | 1185 | 1282 | 12 |
| 1400 | 1685 | 1590 | 50 | 36 | M45 | 60 | — | — | — | 1385 | 1482 | 12 |
| 1500 | 1820 | 1710 | 57 | 36 | M52 | 62,5 | — | — | — | 1485 | 1586 | 12 |
| 1600 | 1930 | 1820 | 57 | 40 | M52 | 65 | — | — | — | 1585 | 1696 | 12 |
| 1800 | 2130 | 2020 | 57 | 44 | M52 | 70 | — | — | — | 1785 | 1896 | 15 |
| 2000 | 2345 | 2230 | 62 | 48 | M56 | 75 | — | — | — | 1985 | 2100 | 15 |


1) See table 14 for an explanation of the abbreviated iron designations.
 2) For ductile iron pipes and fittings the outside diameters for the following flanges shall be:
 - for DN 250 *D* = 400 mm
 - for DN 300 *D* = 455 mm.
 3) These flange thicknesses are also valid for ductile iron flanges type 21-2.
 4) According to prEN 1092-1, steel flanges in this DN and PN may be supplied with 8 holes. For compliance with these, equivalent cast iron flanges may be supplied with eight holes, as special order and after agreement between manufacturer and customer.

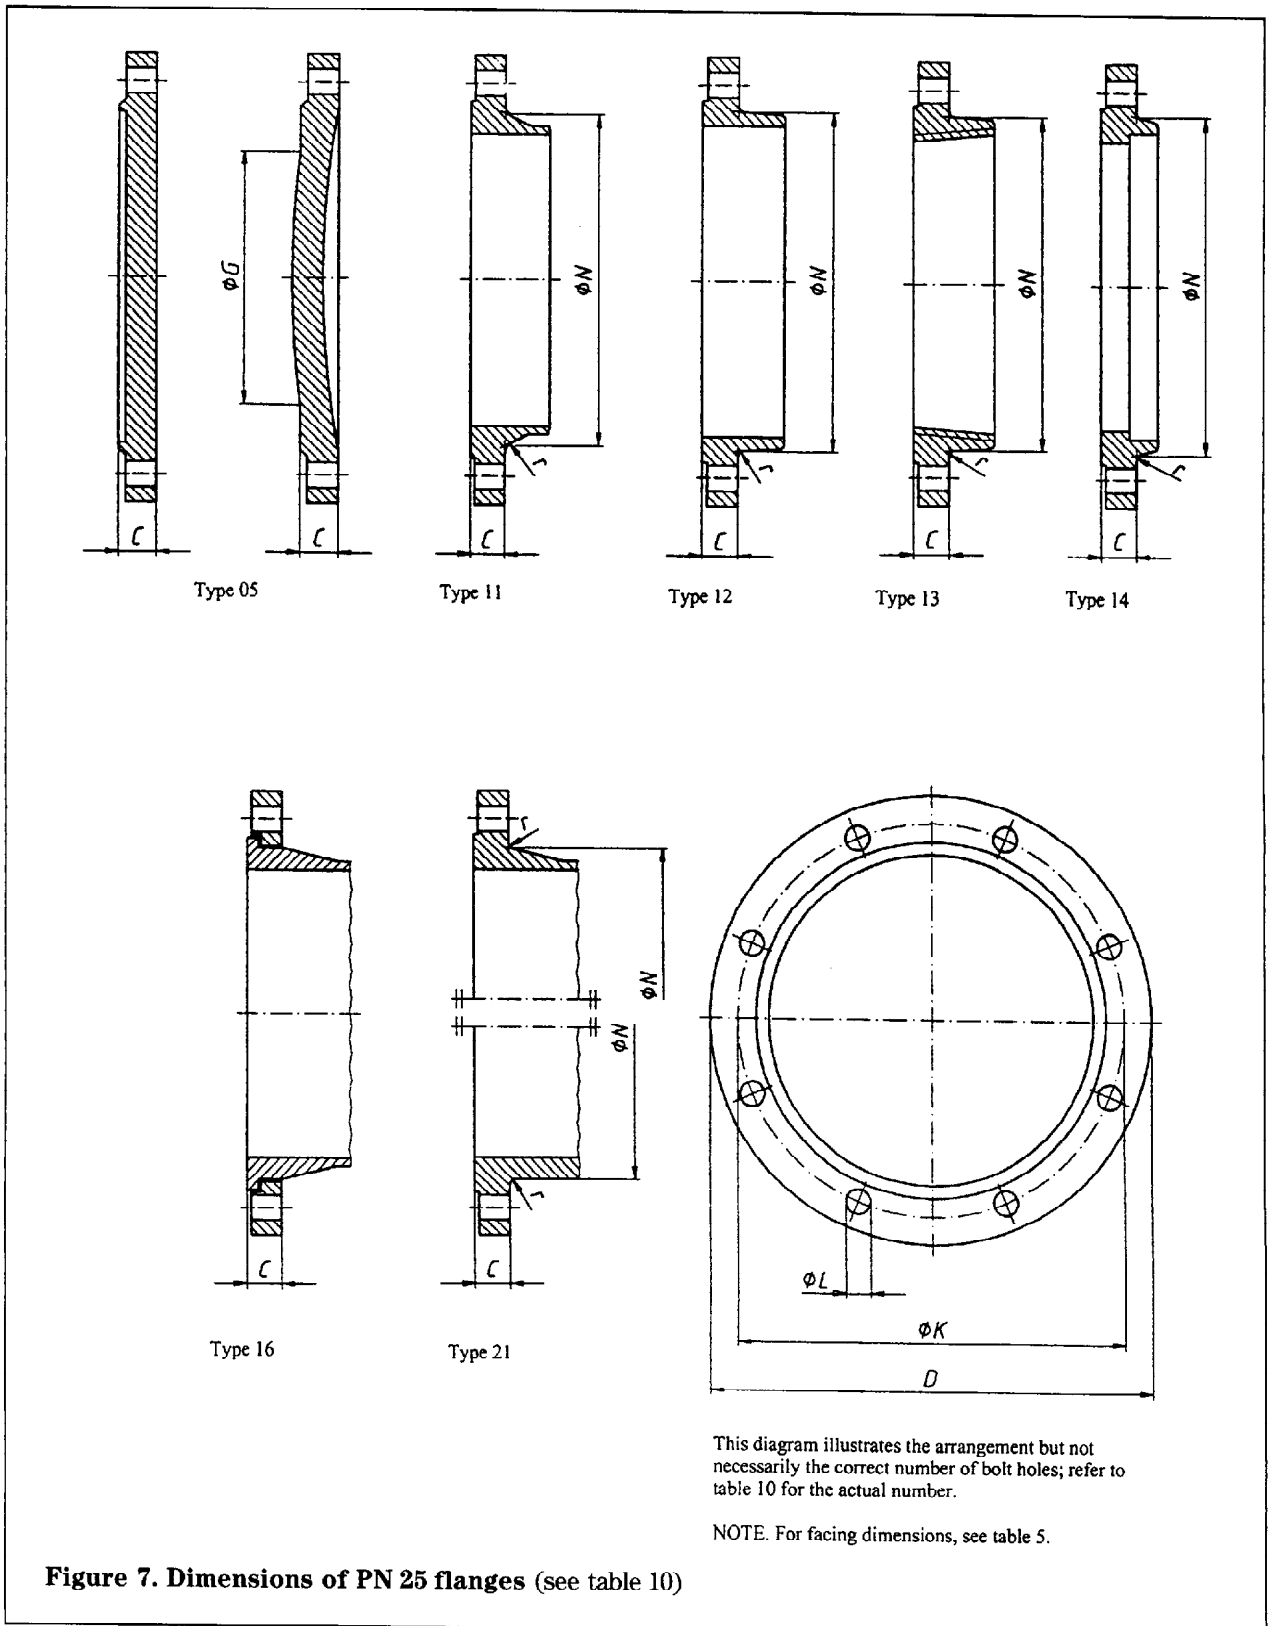

| Table 10. Dimensions of PN 25 flanges (see figure 7 and annex B) | | | | | | | | | | | | |
|--|--|-------------------------------------|-----------------------------------|--------|--------------|-------------------------|---------------------------|-------------------------|--|---------------------------|--------------------------|----------------------|
| Dimensions in millimetres | | | | | | | | | | | | |
| DN | Mating dimensions | | | | | Flange thickness | | | Maximum diameter of shoulder <i>G</i> | Neck diameter <i>N</i> | Corner radii <i>r</i> | |
| | Outside diameter of flange <i>D</i> | Diameter of bolt circle <i>K</i> | Diameter of bolt hole <i>L</i> | Bolts | | <i>DI</i> ¹⁾ | <i>GI</i> ¹⁾²⁾ | <i>MI</i> ¹⁾ | | | | |
| | | | | Number | Nominal size | | | | | | | |
| Flange type | | | | | | <i>C</i> | <i>C</i> | <i>C</i> | <i>G</i> | <i>N</i> | <i>r</i> | |
| 05/11/12/13/14/16/21 | | | | | | 05/11 12/13 14/21 | 16 | 05 21 | 05/13 21 | 05 | 11/12 13/14 21 | 11/12 13/14 21 |
| 0 | | | | | | 14 | | | | | | |
| 15 | | | | | | 14 | | | | | | |
| 20 | | | | | | 16 | | | | | | |
| 25 | | | | | | 16 | | | | | | |
| 32 | | | | | | 18 | | | | | | |
| 40 | | | | | | Use PN 40 dimensions | | | | | | |
| 50 | | | | | | Use PN 40 dimensions | | | | | | |
| 60 | | | | | | Use PN 40 dimensions | | | | | | |
| 65 | | | | | | Use PN 40 dimensions | | | | | | |
| 80 | | | | | | Use PN 40 dimensions | | | | | | |
| 100 | | | | | | Use PN 40 dimensions | | | | | | |
| 125 | 270 | 220 | 28 | 8 | M24 | 19 | 24,5 | 30 | 26 | — | 162 | 6 |
| 150 | 300 | 250 | 28 | 8 | M24 | 20 | 26 | 34 | 28 | — | 192 | 8 |
| 200 | 360 | 310 | 28 | 12 | M24 | 22 | 29 | 34 | 30 | — | 252 | 8 |
| 250 | 425 | 370 | 31 | 12 | M27 | 24,5 | 32 | 36 | 32 | — | 304 | 10 |
| 300 | 485 | 430 | 31 | 16 | M27 | 27,5 | 36 | 40 | 34 | — | 364 | 10 |
| 350 | 555 | 490 | 34 | 16 | M30 | 30 | 39 | 44 | — | 335 | 418 | 10 |
| 400 | 620 | 550 | 37 | 16 | M33 | 32 | 42 | 48 | — | 385 | 472 | 10 |
| 450 | 670 | 600 | 37 | 20 | M33 | 34,5 | 45 | 50 | — | 435 | 520 | 12 |
| 500 | 730 | 660 | 37 | 20 | M33 | 36,5 | 48 | 52 | — | 485 | 580 | 12 |
| 600 | 845 | 770 | 41 | 20 | M36 | 42 | 55 | 56 | — | 585 | 684 | 12 |
| 700 | 960 | 875 | 44 | 24 | M39 | 46,5 | — | — | — | 685 | 780 | 12 |
| 800 | 1085 | 990 | 50 | 24 | M45 | 51 | — | — | — | 785 | 882 | 12 |
| 900 | 1185 | 1090 | 50 | 28 | M45 | 55,5 | — | — | — | 885 | 982 | 12 |
| 1000 | 1320 | 1210 | 57 | 28 | M52 | 60 | — | — | — | 985 | 1086 | 12 |
| 1100 | 1420 | 1310 | 57 | 32 | M52 | 64,5 | — | — | — | 1085 | 1186 | 12 |
| 1200 | 1530 | 1420 | 57 | 32 | M52 | 69 | — | — | — | 1185 | 1296 | 12 |
| 1400 | 1755 | 1640 | 62 | 36 | M56 | 74 | — | — | — | 1385 | 1508 | 12 |
| 1500 | 1865 | 1750 | 62 | 36 | M56 | 77,5 | — | — | — | 1485 | 1617 | 12 |
| 1600 | 1975 | 1860 | 62 | 40 | M56 | 81 | — | — | — | 1585 | 1726 | 12 |
| 1800 | 2195 | 2070 | 70 | 44 | M64 | 88 | — | — | — | 1785 | 1920 | 15 |
| 2000 | 2425 | 2300 | 70 | 48 | M64 | 95 | — | — | — | 1985 | 2150 | 15 |

¹⁾ See table 14 for an explanation of the abbreviated iron designations.

²⁾ These flange thicknesses are also valid for ductile iron flanges type 21-2.

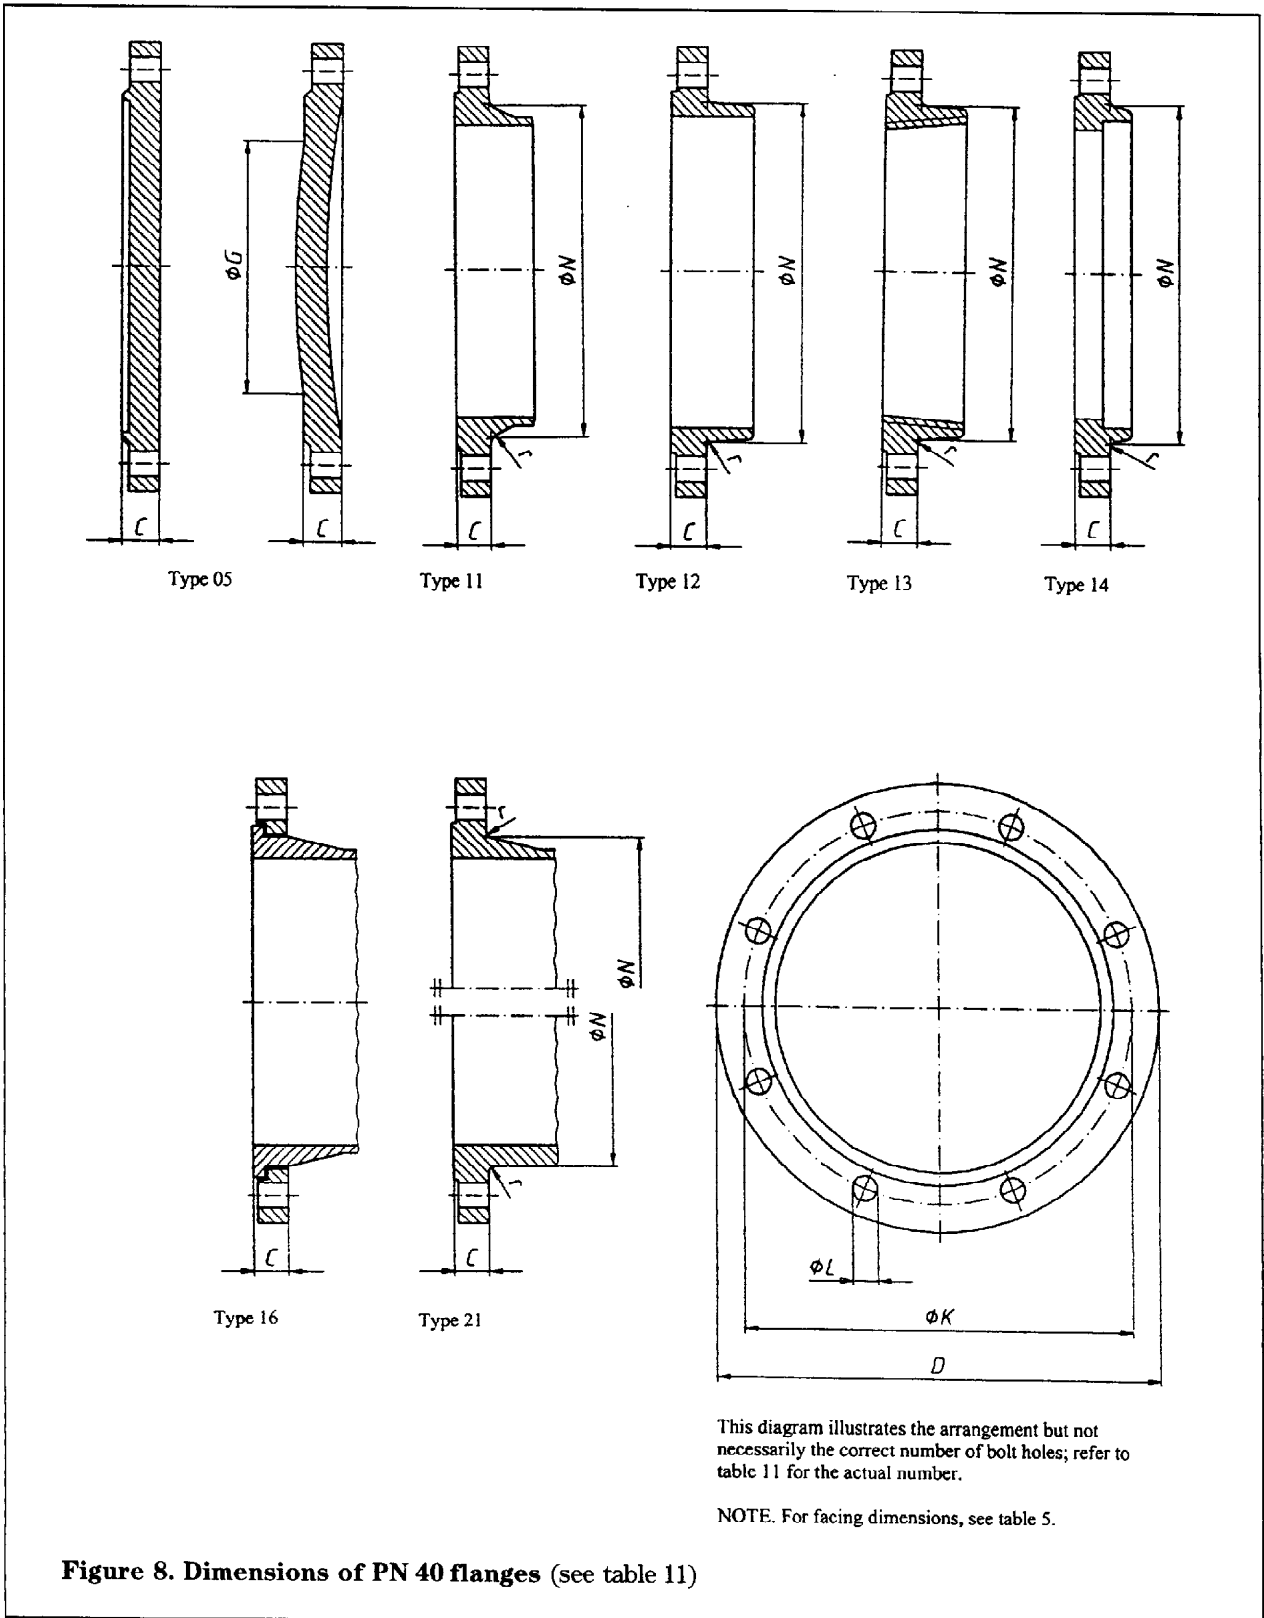

| Table 11. Dimensions of PN 40 flanges (see figure 8 and annex B) | | | | | | | | | | | | |
|--|--|-------------------------------------|-----------------------------------|--------|--------------|------------------------------|--------------------------------|------------------------------|--|---------------------------|--------------------------|----------------------|
| Dimensions in millimetres | | | | | | | | | | | | |
| DN | Mating dimensions | | | | | Flange thickness | | | Maximum diameter of shoulder <i>G</i> | Neck diameter <i>N</i> | Corner radii <i>r</i> | |
| | Outside diameter of flange <i>D</i> | Diameter of bolt circle <i>K</i> | Diameter of bolt hole <i>L</i> | Bolts | | DI ¹⁾ <i>C</i> | GI ¹⁾²⁾ <i>C</i> | MI ¹⁾ <i>C</i> | | | | |
| | | | | Number | Nominal size | | | | | | | |
| Flange type | | | | | | | | | | | | |
| 05/11/12/13/14/16/21 | | | | | | 05/11 12/13 14/21 | 16 | 05 21 | 05/13 21 | 05 | 11/12 13/14 21 | 11/12 13/14 21 |
| 10 | 90 | 60 | 14 | 4 | M12 | — | — | 16 | 14 | — | 28 | 3 |
| 15 | 95 | 65 | 14 | 4 | M12 | — | — | 16 | 14 | — | 32 | 3 |
| 20 | 105 | 75 | 14 | 4 | M12 | — | — | 18 | 16 | — | 40 | 4 |
| 25 | 115 | 85 | 14 | 4 | M12 | — | — | 18 | 16 | — | 50 | 4 |
| 32 | 140 | 100 | 19 | 4 | M16 | — | — | 20 | 18 | — | 60 | 5 |
| 40 | 150 | 110 | 19 | 4 | M16 | 19 | 22 | 20 | 18 | — | 70 | 5 |
| 50 | 165 | 125 | 19 | 4 | M16 | 19 | 22 | 22 | 20 | — | 84 | 5 |
| 60 | 175 | 135 | 19 | 8 | M16 | 19 | 22 | 24 | 22 | — | 94 | 6 |
| 65 | 185 | 145 | 19 | 8 | M16 | 19 | 22 | 24 | 22 | — | 104 | 6 |
| 80 | 200 | 160 | 19 | 8 | M16 | 19 | 22 | 26 | 24 | — | 120 | 6 |
| 100 | 235 | 190 | 23 | 8 | M20 | 19 | 23 | 28 | 24 | — | 142 | 6 |
| 125 | 270 | 220 | 28 | 8 | M24 | 23,5 | 24,5 | 30 | 26 | — | 162 | 6 |
| 150 | 300 | 250 | 28 | 8 | M24 | 26 | 26 | 34 | 28 | — | 192 | 8 |
| 200 | 375 | 320 | 31 | 12 | M27 | 30 | 33 | 40 | 34 | — | 254 | 8 |
| 250 | 450 | 385 | 34 | 12 | M30 | 34,5 | 37 | 46 | 38 | — | 312 | 10 |
| 300 | 515 | 450 | 34 | 16 | M30 | 39,5 | 42 | 50 | 42 | — | 378 | 10 |
| 350 | 580 | 510 | 37 | 16 | M33 | 44 | 46 | 54 | — | 335 | 432 | 10 |
| 400 | 660 | 585 | 41 | 16 | M36 | 48 | — | 62 | — | 385 | 498 | 10 |
| 450 | 685 | 610 | 41 | 20 | M36 | 49 | — | — | — | 435 | 522 | 12 |
| 500 | 755 | 670 | 44 | 20 | M39 | 52 | — | — | — | 485 | 576 | 12 |
| 600 | 890 | 795 | 50 | 20 | M45 | 58 | — | — | — | 585 | 686 | 12 |

¹⁾ See table 14 for an explanation of the abbreviated iron designations.
²⁾ These flange thicknesses are also valid for ductile iron flanges type 21-2.

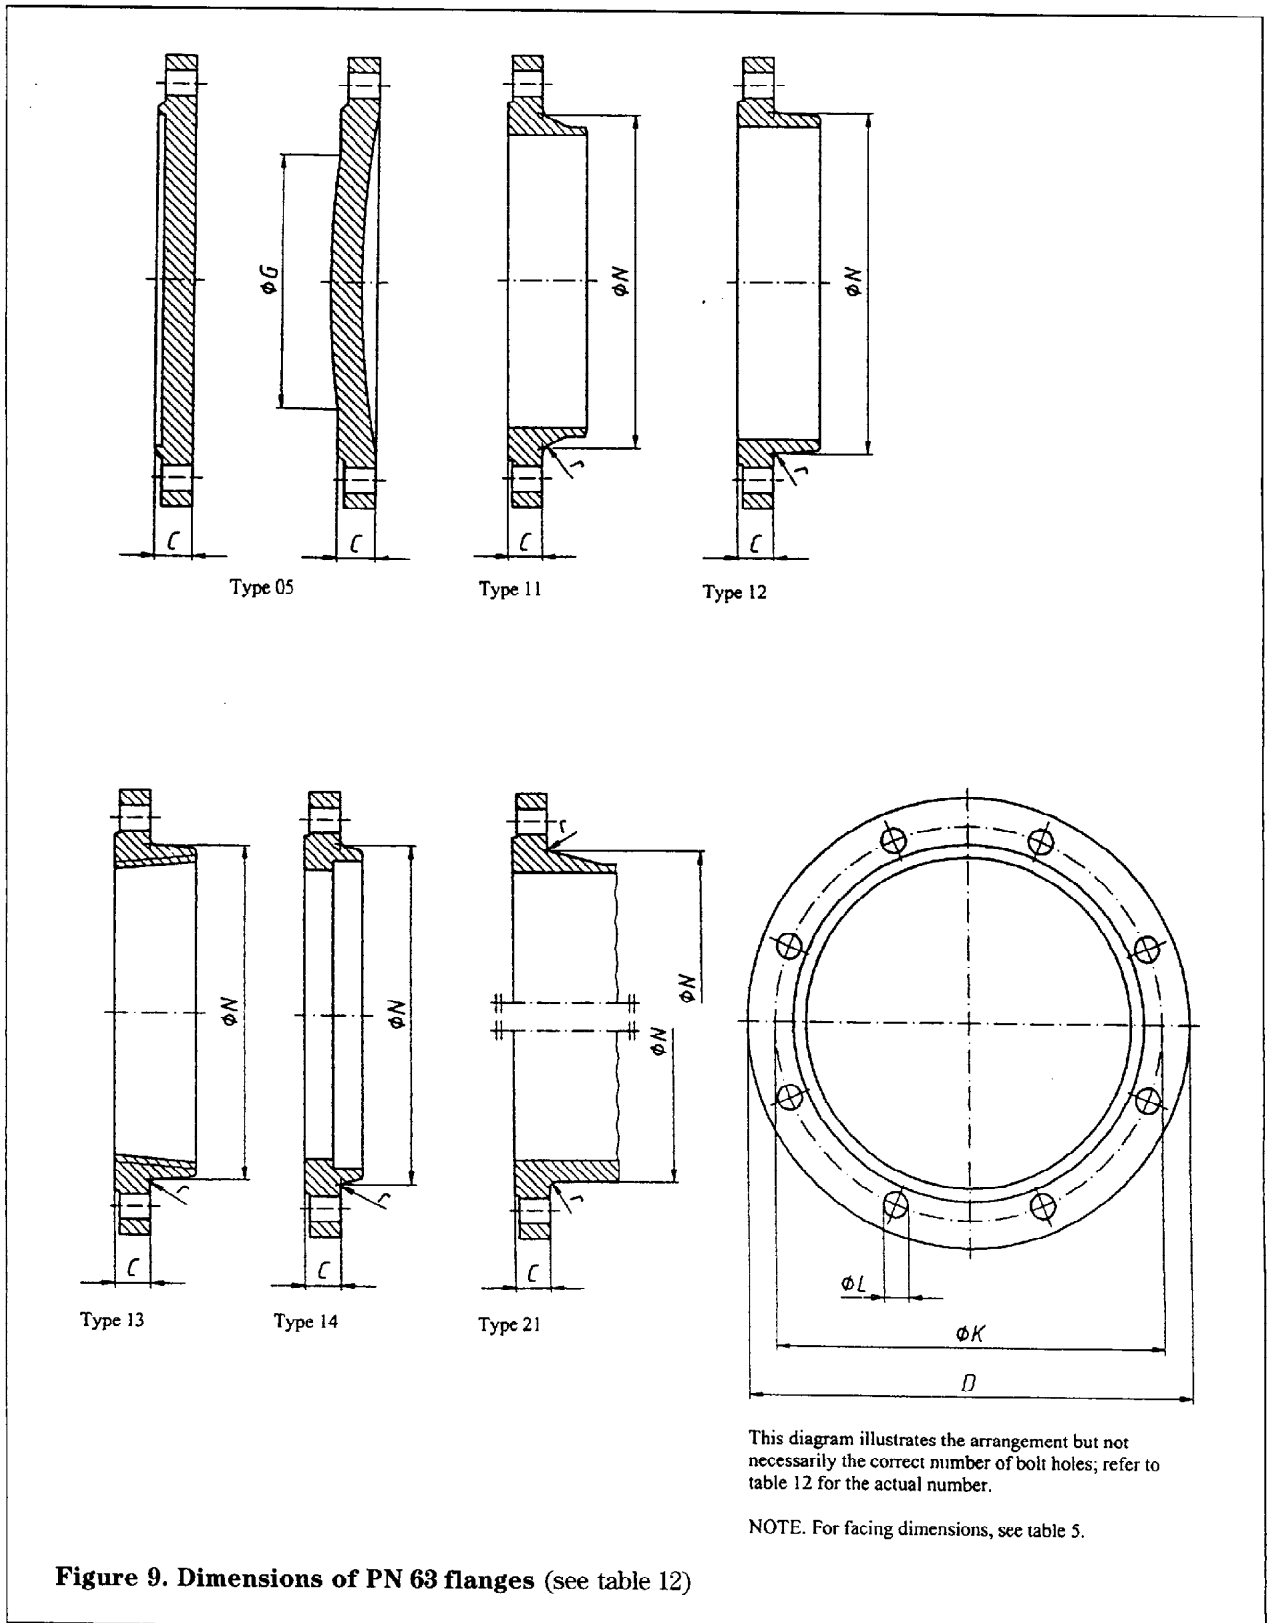



Figure 9. Dimensions of PN 63 flanges (see table 12)

Table 12. Dimensions of PN 63 flanges (see figure 9 and annex B)

Dimensions in millimetres

| DN | Mating dimensions | | | | | Flange thickness DI ¹⁾ <i>C</i> | Maximum diameter of shoulder <i>G</i> | Neck diameter <i>N</i> | Corner radii <i>r</i> |
|-------------------|--|-------------------------------------|-----------------------------------|--------|--------------|--|--|---------------------------|--------------------------|
| | Outside diameter of flange <i>D</i> | Diameter of bolt circle <i>K</i> | Diameter of bolt hole <i>L</i> | Bolts | | | | | |
| | | | | Number | Nominal size | | | | |
| Flange type | | | | | | | | | |
| 05/11/12/13/14/21 | | | | | | 05/21 | 05 | 11/12/13/14/21 | |
| 40 | 170 | 125 | 23 | 4 | M20 | 28 | — | 77 | 5 |
| 50 | 180 | 135 | 23 | 4 | M20 | 28 | — | 87 | 5 |
| 60 | 190 | 145 | 23 | 8 | M20 | 28 | — | 97 | 6 |
| 65 | 205 | 160 | 23 | 8 | M20 | 28 | — | 112 | 6 |
| 80 | 215 | 170 | 23 | 8 | M20 | 31 | — | 122 | 6 |
| 100 | 250 | 200 | 28 | 8 | M24 | 33 | — | 142 | 6 |
| 125 | 295 | 240 | 31 | 8 | M27 | 37 | — | 174 | 6 |
| 150 | 345 | 280 | 34 | 8 | M30 | 39 | — | 208 | 8 |
| 200 | 415 | 345 | 37 | 12 | M33 | 46 | — | 267 | 8 |
| 250 | 470 | 400 | 37 | 12 | M33 | 50 | — | 322 | 10 |
| 300 | 530 | 460 | 37 | 16 | M33 | 57 | — | 382 | 10 |
| 350 | 600 | 525 | 41 | 16 | M36 | 61 | 335 | 438 | 10 |
| 400 | 670 | 585 | 44 | 16 | M39 | 65 | 385 | 490 | 10 |

¹⁾ See table 14 for an explanation of the abbreviated iron designations.

| Table 13. Tolerances on dimensions | | Linear dimensions in millimetres | | | | | |
|--------------------------------------|--|---|------------|------------|-------------|------------|-------|
| Symbol | Designation | Tolerances | | | | | |
| <i>D</i> | Outside diameter | Not specified but the minimum shall provide a sufficient bearing area for standard hexagonal bolt | | | | | |
| <i>d</i> | For DN | ≤ 100 | 125 to 300 | 350 to 600 | 700 to 1200 | ≥ 1400 | |
| | Facing diameter | -4 | -4,5 | -5 | -5,5 | -6 | |
| | Tolerance | Maximum diameter can be greater than the nominal value, but no plus tolerance is given in this standard | | | | | |
| <i>f</i> | Facing height | <i>f</i> = 1 mm minimum | | | | | |
| <i>b</i> (= <i>c</i> - <i>f</i>) | Thickness | ≤ 35 | 36 to 45 | 46 to 60 | 61 to 75 | > 76 | |
| | Flange thickness | +4 -3 | +4,5 -4 | +5 -4 | +6 -5 | +7 -6 | |
| <i>L</i> | Bolt hole diameter | ≤ M33 | M36 to M39 | M45 to M52 | | > M52 | |
| | | +1,5 0 | +2 0 | +2,5 0 | | | |
| | | M10 | M12 | M14 to M20 | M24 to M33 | M36 to M52 | > M52 |
| | Position of bolt hole ¹⁾  ²⁾ | 1 | 2 | 3 | 4 | 5 | 6 |
| | Facing draught angle | ≤ 2° | | | | | |

¹⁾ The position of bolt holes takes into account the tolerances on bolt circle diameter and centre to centre.

²⁾ For explanation see ISO 5458 : 1987.

| Type | Material | Grade | PN ¹⁾ | | | | | | |
|-------------------|--------------------|--------|------------------|----|----|----|----|----|----|
| | Reference standard | | 2,5 | 6 | 10 | 16 | 25 | 40 | 63 |
| Ductile iron DI | ISO 1083 : 1987 | 350-22 | | | × | × | × | × | × |
| | ISO 1083 : 1987 | 400-15 | | | × | × | × | × | × |
| | ISO 1083 : 1987 | 400-18 | 2) | 2) | × | × | × | × | × |
| | EN 545 | 420-5 | | | × | × | × | × | × |
| | ISO 1083 : 1987 | 500-7 | | | × | × | × | × | × |
| | ISO 1083 : 1987 | 600-3 | | | × | × | × | × | × |
| Grey iron GI | ISO 185 : 1988 | 200 | × | × | × | × | | | |
| | ISO 185 : 1988 | 250 | × | × | × | × | × | × | |
| Malleable iron MI | ISO 5922 : 1981 | B30-06 | | × | × | × | | | |
| | ISO 5922 : 1981 | B32-12 | | × | × | × | × | × | |
| | ISO 5922 : 1981 | B35-10 | | × | × | × | × | × | |

¹⁾ × means that this grade may be used for this PN.
²⁾ Type 21-2 flanges in PN 2,5 and PN 6 are possible by agreement between manufacturer and purchaser (see notes to tables 6 and 7).

| PN | Temperature °C | | | | | |
|----|---|------|------|------|------|------|
| | - 10 to 120 | 150 | 200 | 250 | 300 | 350 |
| | Allowable non-shock pressure ²⁾ in bar | | | | | |
| 10 | 10 ³⁾ | 9,5 | 9 | 8 | 7 | 5,5 |
| 16 | 16 | 15,2 | 14,4 | 12,8 | 11,2 | 8,8 |
| 25 | 25 | 23,8 | 22,5 | 20 | 17,5 | 13,8 |
| 40 | 40 | 38 | 36 | 32 | 28 | 22 |
| 63 | 63 | 60,8 | 57,6 | 51,2 | 44,8 | 35,2 |

¹⁾ Ductile iron grade 600-3 flanges are limited to applications up to a temperature of 120 °C.
²⁾ See also 5.5.
³⁾ See table 8.

| PN | Temperature °C | | | | | |
|----|---|------|------|------|------|------|
| | - 10 to 120 | 150 | 200 | 250 | 300 | 350 |
| | Allowable non-shock pressure ¹⁾ in bar | | | | | |
| 10 | 10 ²⁾ | 9,7 | 9,2 | 8,7 | 8 | 7 |
| 16 | 16 | 15,5 | 14,7 | 13,9 | 12,8 | 11,2 |
| 25 | 25 | 24,3 | 23 | 21,8 | 20 | 17,5 |
| 40 | 40 | 38,8 | 36,8 | 34,8 | 32 | 28 |
| 63 | 63 | 62 | 58,8 | 55,6 | 51,2 | 44,8 |

¹⁾ See also 5.5.
²⁾ See table 8.

Table 17. Pressure/temperature ratings for grey iron flanges (ISO 185 : 1988 grades 200 and 250)

| PN | Temperature °C | | | | | | |
|------------------|---|------|------|------|------|------|-----|
| | -10 to 120 | 150 | 180 | 200 | 230 | 250 | 300 |
| | Allowable non-shock pressure ¹⁾ in bar | | | | | | |
| 2,5 | 2,5 | 2,3 | 2,1 | 2 | 1,9 | 1,8 | 1,5 |
| 6 | 6 | 5,4 | 5 | 4,8 | 4,4 | 4,2 | 3,6 |
| 10 | 10 | 9 | 8,4 | 8 | 7,4 | 7 | 6 |
| 16 | 16 | 14,4 | 13,4 | 12,8 | 11,8 | 11,2 | 9,6 |
| 25 ²⁾ | 25 | 22,5 | 21 | 20 | 18,5 | 17,5 | 15 |
| 40 ²⁾ | 40 | 36 | 33,6 | 32 | 29,6 | 28 | 24 |

¹⁾ See also 5.5.
²⁾ PN 25 and PN 40 flanges manufactured in grey iron are limited to ISO 185 : 1988 grade 250.

Table 18. Pressure/temperature ratings for malleable iron flanges (ISO 5922 : 1981 grades B30-06, B32-12 and B35-10)

| PN | Temperature °C | | | | | |
|----|---|------|------|------|------|------|
| | -10 to 120 | 150 | 200 | 250 | 300 | 350 |
| | Allowable non-shock pressure ¹⁾ in bar | | | | | |
| 6 | 6 | 5,8 | 5,5 | 5,2 | 4,8 | 4,2 |
| 10 | 10 | 9,7 | 9,2 | 8,7 | 8 | 7 |
| 16 | 16 | 15,5 | 14,7 | 13,9 | 12,8 | 11,2 |
| 25 | 25 | 24,3 | 23 | 21,8 | 20 | 17,5 |
| 40 | 40 | 38,8 | 36,8 | 34,8 | 32 | 28 |

¹⁾ See also 5.5.



Annex A (normative)

Information to be supplied by the purchaser

When a purchaser orders separate flanges which are supplied not attached to a pipeline component in accordance with this standard, it shall state in his enquiry and/or order the following information:

- a) standard designation (see 4.4) and b) and c) if appropriate as follows;
- b) for flange types 11, 12 and 14, the external diameter and thickness of pipe to which the flange is to be attached (see note 3 in annex B) when supplied separate, i.e. not as a part of some other pipe line component;
- c) type of thread for threaded flanges (type 13) when supplied separate, i.e. not as a part of some other pipe line component.

NOTE. Where appropriate, information required for items b) and c) should be agreed between purchaser and manufacturer.

Example 1:

For flanges in malleable iron type 11, 12 or 14:

Flange/ EN 1092-2/ DN 100/ PN 40/ type 11/ MI B 30-06/ A/ \varnothing 120 \times 5

Example 2:

For flanges in malleable iron type 13:

Flange/ EN 1092-2/ DN 100/ PN 40/ type 13/ MI B 30-06/ A/ \varnothing 118 \times 2

Example 3:

For flanges in materials other than malleable iron:

Flange/ EN 1092-2/ DN 100/ PN 40/ type 11/ DI 400-15/ -/ \varnothing 120 \times 5

Annex B (informative)

Notes to tables 6 to 12

NOTE 1. All PN's : for dimensions d and f , see table 5.

NOTE 2. The origins of the flange thicknesses are:

For ductile iron those from ISO 2531 : 1991.

For grey and malleable irons those from ISO 7005-2 : 1988.

NOTE 3. Pipe dimensions affect the bore of the flange, and the external diameter and thickness of pipe which is to be joined to the flange should be specified where appropriate. The bore sizes of integral flanges (type 21) on valves, fittings or accessories to which they form a part may be given in the appropriate standard for the component.

NOTE 4. N is a reference dimension located at the intersection of the projection of the hub draft angle and the back face of the flange. For certain designs of flange e.g. flanges which are integral with pumps or valves, it may be impossible to use N and r .

NOTE 5. Dimension G is the limit of the shoulder at the intersection with the projection of the sealing face. It is intended to prevent any interference between this shoulder and the bore of the mating flange.

Annex C (informative)

Bibliography

ISO 13 : 1978 *Cast iron pipes, fittings and accessories for pressure pipelines*

EN 1514 *Flanges and their joints. Dimensions of gaskets for PN designated flanges (in several parts)*

List of references

See national foreword.



S

BSI — British Standards Institution

BSI is the independent national body responsible for preparing British Standards. It presents the UK view on standards in Europe and at the international level. It is incorporated by Royal Charter.

Contract requirements

A British Standard does not purport to include all the necessary provisions of a contract. Users of British Standards are responsible for their correct application.

Revisions

British Standards are updated by amendment or revision. Users of British Standards should make sure that they possess the latest amendments or editions.

It is the constant aim of BSI to improve the quality of our products and services. We would be grateful if anyone finding an inaccuracy or ambiguity while using this British Standard would inform the Secretary of the responsible technical committee, the identity of which can be found on the inside front cover. Tel: 0181 996 9000; Fax: 0181 996 7400.

BSI offers members an individual updating service called PLUS which ensures that subscribers automatically receive the latest editions of standards.

Buying standards

Orders for all BSI, international and foreign standards publications should be addressed to Customer Services, Sales Department at Chiswick: Tel: 0181 996 7000; Fax: 0181 996 7001.

In response to orders for international standards, it is BSI policy to supply the BSI implementation of those that have been published as British Standards, unless otherwise requested.

Information on standards

BSI provides a wide range of information on national, European and international standards through its Library, the Standardline Database, the BSI Information Technology Service (BITS) and its Technical Help to Exporters Service. Contact the Information Department at Chiswick: Tel: 0181 996 7111; Fax: 0181 996 7048.

Subscribing members of BSI are kept up to date with standards developments and receive substantial discounts on the purchase price of standards. For details of these and other benefits contact Customer Services, Membership at Chiswick: Tel: 0181 996 7002; Fax: 0181 996 7001.

Copyright

Copyright subsists in all BSI publications. BSI also holds the copyright, in the UK, of the publications of the international standardization bodies. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI.

This does not preclude the free use, in the course of implementing the standard, of necessary details such as symbols, and size, type or grade designations. If these details are to be used for any other purpose than implementation then the prior written permission of BSI must be obtained.

If permission is granted, the terms may include royalty payments or a licensing agreement. Details and advice can be obtained from the Copyright Manager, BSI, 389 Chiswick High Road, London W4 4AL.